

NEW CONSTRUCTION FOR
JOYCE STEINFELD
2366 RAINBOW COURT

CODE COMPLIANCE	SHEET INDEX	SQUARE FOOTAGE SUMMARY	PROJECT TEAM
COMPLIES WITH THE 2016 CBC, CRC, CMC, CPC, CEC, AND TITLE 24 ENERGY REQUIRMENTS & CAL GREEN.	DRAWING LIST CS COVER SHEET TOPOGRAPHICAL SURVEY L1.0 SITE PLAN CO1 GRADING PLAN L2.0 LANDSCAPE L3.0 IRRIGATION L4.0 PLANTING 1 ELEVATIONS 2 ELEVATIONS 3 FIRST FLOOR PLAN 4 SECOND FLOOR PLAN	LOT AREA 14375 S.F. 1ST FLOOR 1184 S.F. 2ND FLOOR 1516 S.F. GARAGE SPACE 528 S.F. COVERED PORCH 56 S.F. REAR DECK 168 S.F. LOT COVERAGE 13.3%	Civil Engineer Ambrose Wong PE, QSD Green Civil Engineering, Inc. 1900 S. Norfolk St. # 350 San Mateo, CA. 94403 650-931-2514 awong@green-ce.com Land Surveyor Keith Nofield, PLS. 5178 Wowry Ave. Ste. #2151 Fremont, CA. 94538 510-468-2703 kno77393@gmail.com Geologist Barry Milstone 17020 Melody Lane Los Gatos, CA. 95033 408-353-5528 phone 802-448-1025 fax bsm@milstonegeo.com www.milstonegeo.com Landscape Architect Jeni Webber + Associates 1743 Alcatraz Ave. Berkeley, CA. 94703 Jeni Webber 510-841-3311 phone 510-450-9091 fax jeni@jenwebber.com Structural Engineer Norman Scheel Structural Engineer 5022 Sunrise Blvd. Fair Oaks CA 95628 916-536-9585
SCOPE OF WORK		ASSESSORS PARCEL NO.	
SINGLE FAMILY RESIDENCE OF APPROXIMATELY 2700 S.F. LIVING SPACE WITH ATTACHED GARAGE.		425-0410-027	
		DEFERRED SUBMITTAL	
		SPRINKLERS	

OCCUPANCY GROUP R-3/U TYPE OF CONSTRUCTION V-B

REVISIONS	BY

PACIFIC MODERN HOMES
P.O. BOX 670
ELK GROVE, CA. 95759
PHONE: (916) 685-9514



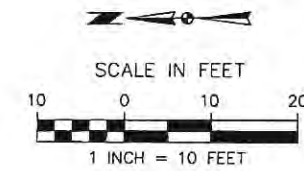
COVER SHEET

PRE-ENGINEERED
JOYCE STEINFELD #9422
2366 RAINBOW COURT
HAYWARD, CA 94542
MANCHESTER

DATE: 5/11/18
SCALE: N.T.S.
DRAWN BY: HW
PLAN NO.: 9422
SHEET: CS

LEGEND:

	SUBJECT PROPERTY LINE
	PROPERTY LINE
	2' CONTOUR LINE
	10' CONTOUR LINE
	SANITARY SEWER
	LIMITS OF HEAVY VEGETATION/TREES
	STANDARD CITY STREET MONUMENT
	AC ASPHALT CONCRETE
	ACP AGGREGATE CONCRETE PIPE
	EL ELEVATION
	FH FIRE HYDRANT
	INV. INVERT
	S.F. SQUARE FEET
	SSMH SANITARY SEWER HANHOLE
	VCP VETRIFIED CLAY PIPE
	WM WATER METER
	WV WATER VALVE
	12" TREE DIAMETER (SPECIES SPECIFIED)
	CONCRETE

**NOTES**

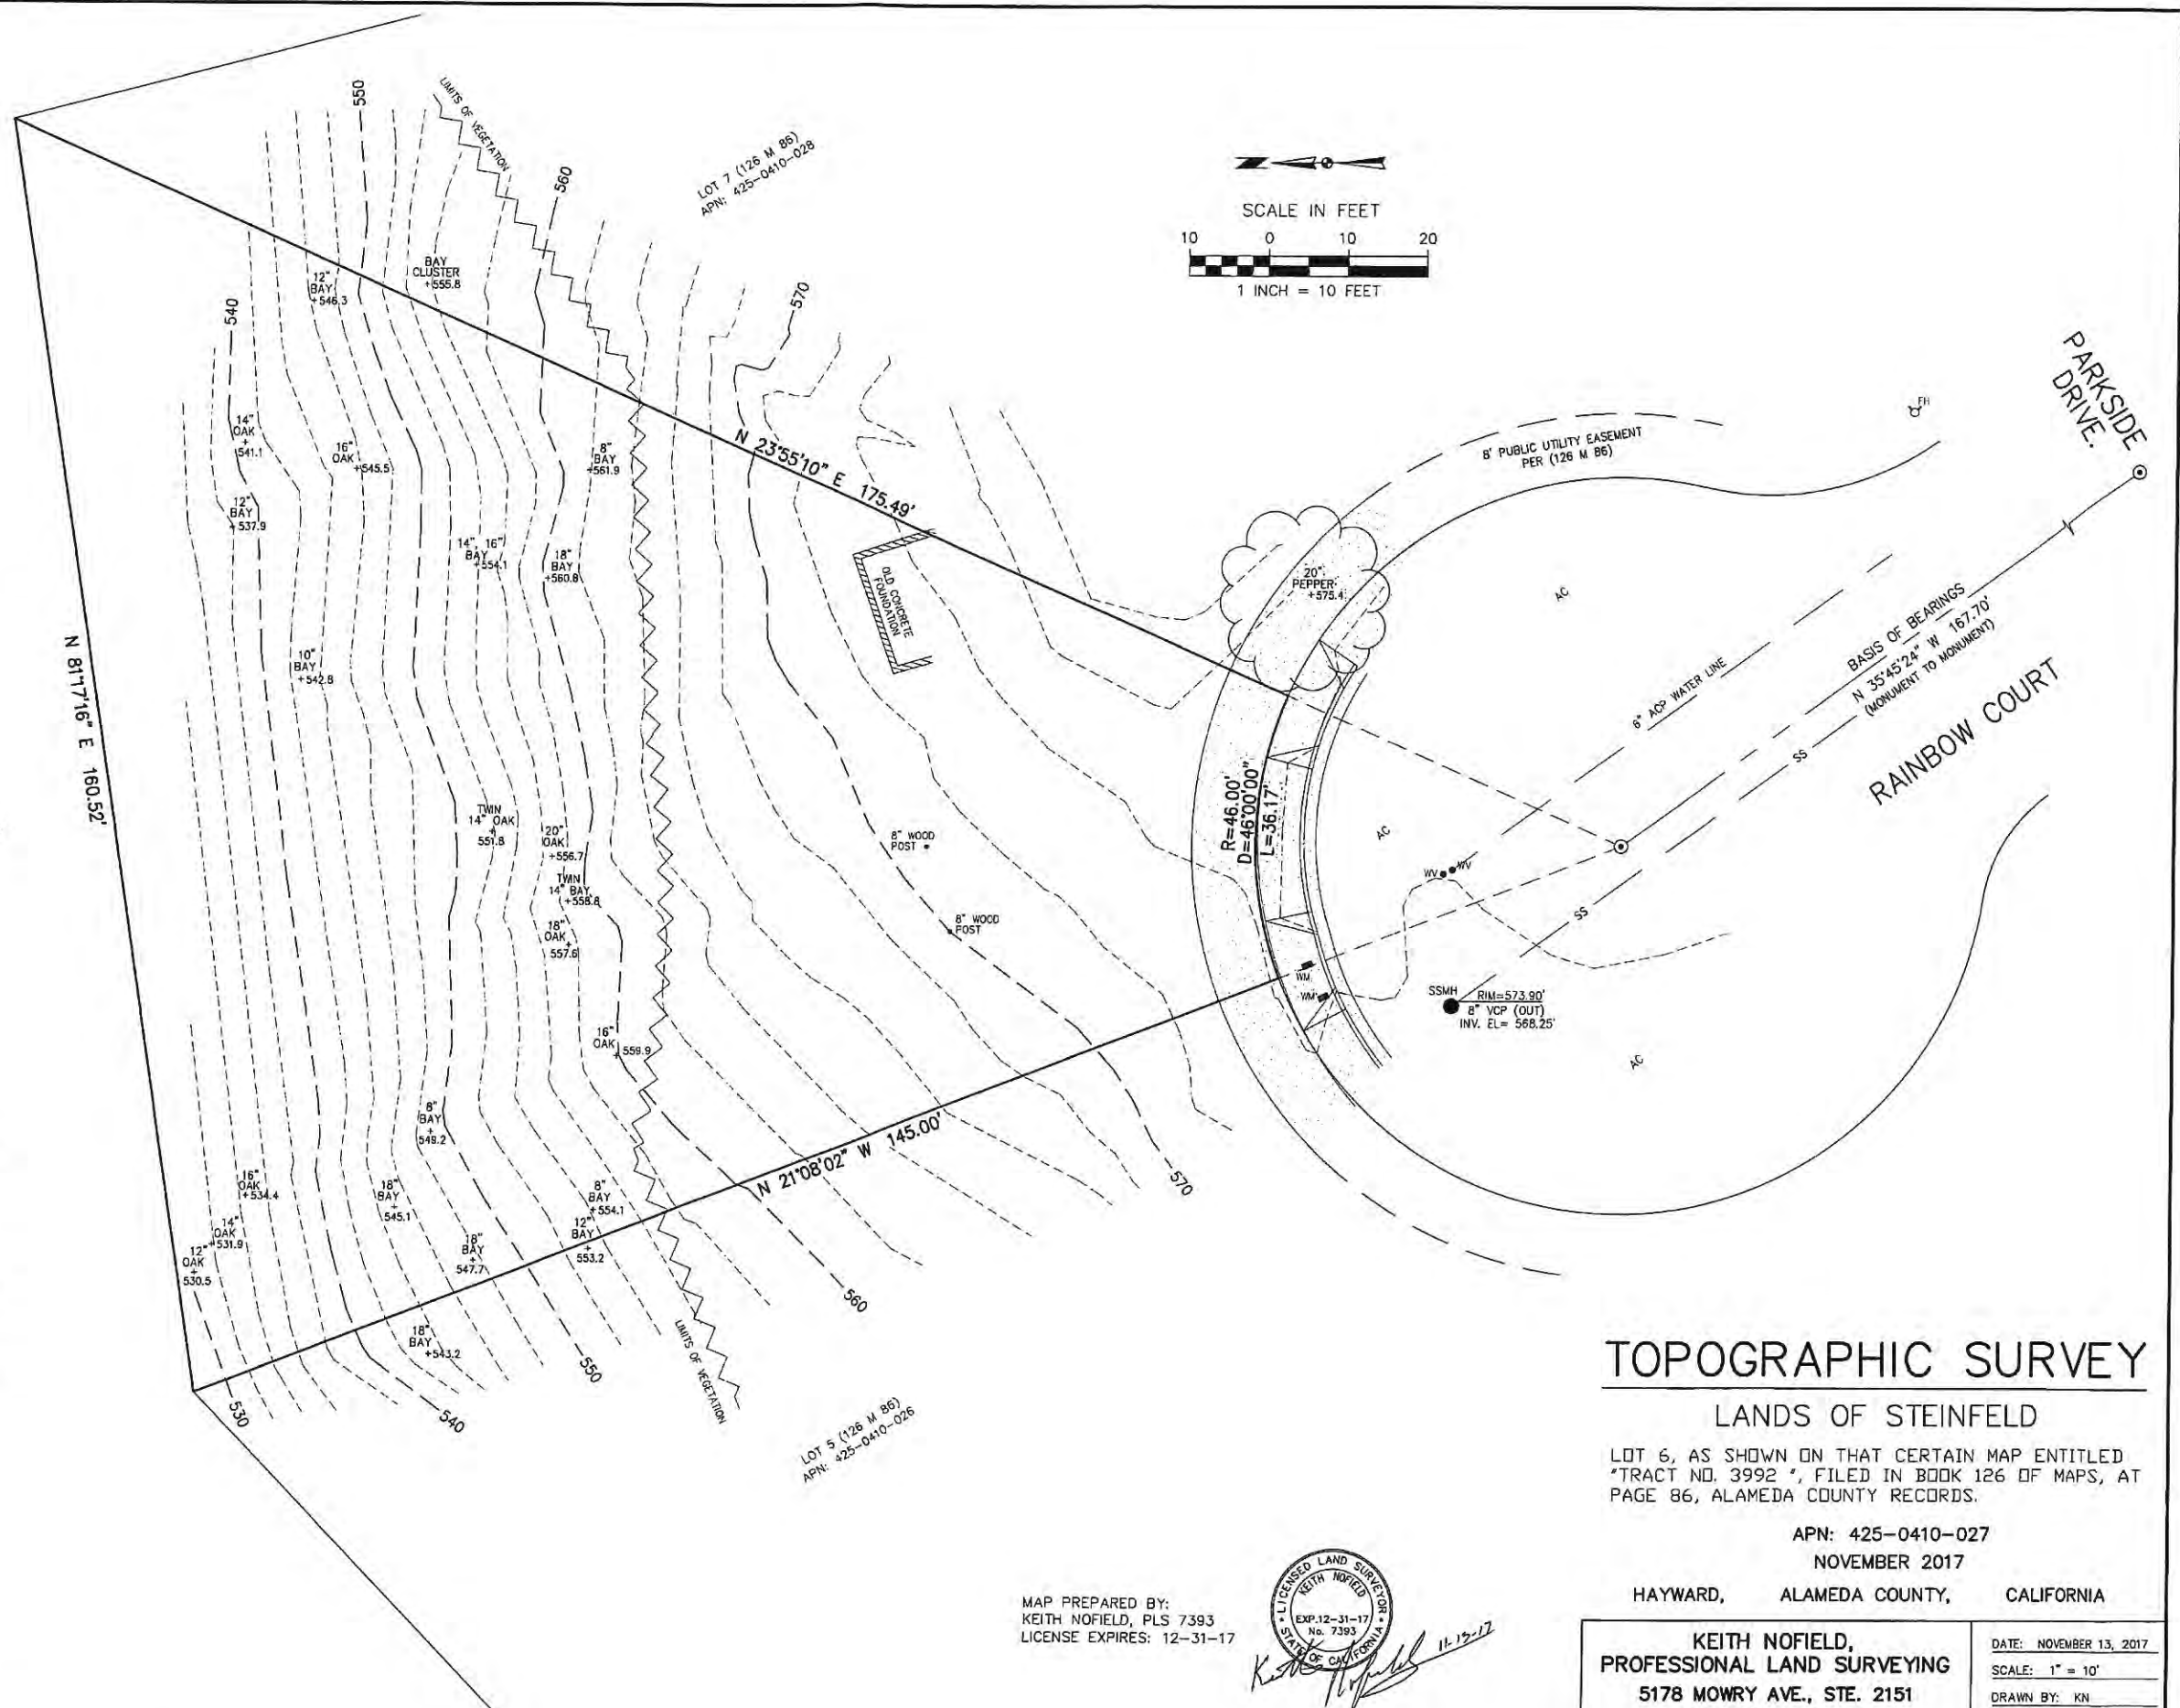
1. UTILITY LOCATIONS ARE ONLY APPROXIMATE AND NOT INTENDED FOR USE WITH CONSTRUCTION. INFORMATION WAS ACQUIRED FROM A FIELD SURVEY. CONTACT "USA" AT 1-800-642-2440 FOR ASSISTANCE WITH LOCATION OF UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION.
2. ALL DISTANCE AND DIMENSIONS ARE IN FEET AND DECIMALS THEREOF.
3. THE TOTAL AREA OF THE SUBJECT PROPERTY IS 14,139± S.F.
4. FEMA FLOOD ZONE (ZONE X - UNSHADED) AREAS DETERMINED TO BE OUTSIDE THE 0.2% ANNUAL CHANCE FLOODPLAIN.
5. ADDRESS OF SUBJECT SITE IS: 2366 RAINBOW COURT
6. SITE REPRODUCTION OF THIS MAP WITH OUT MY PROFESSIONAL LAND SURVEYOR'S SEAL AND SIGNATURE, IS NOT CONSIDERED AN ORIGINAL

BASIS OF BEARINGS:

THE BEARING OF N 35°45'24" W, FOR THE MONUMENT LINE OF RAINBOW COURT, ESTABLISHED FROM THE FOUND STREET MONUMENTS IN RAINBOW COURT, AS SHOWN ON THAT CERTAIN MAP ENTITLED "TRACT NO. 3992" FILED IN BOOK 126 OF MAPS, AT PAGE 86, WAS USED AS THE BASIS FOR THIS MAP.

BENCHMARK:

A TEMPORARY BENCHMARK "TBM" WITH THE ELEVATION OF 573.47' (NAVD 88 DATUM) WAS ESTABLISHED BY GPS METHODS, ON THE TOP OF A STANDARD CITY OF HAYWARD BRASS DISK IN MONUMENT WELL AT THE CENTER OF CUL-DE-SAC OF RAINBOW COURT.

**TOPOGRAPHIC SURVEY****LANDS OF STEINFELD**

LOT 6, AS SHOWN ON THAT CERTAIN MAP ENTITLED "TRACT NO. 3992", FILED IN BOOK 126 OF MAPS, AT PAGE 86, ALAMEDA COUNTY RECORDS.

APN: 425-0410-027

NOVEMBER 2017

HAYWARD, ALAMEDA COUNTY, CALIFORNIA

KEITH NOFIELD,
PROFESSIONAL LAND SURVEYING
 5178 MOWRY AVE., STE. 2151
 FREMONT, CA 94538
 510/468-2703

DATE: NOVEMBER 13, 2017
 SCALE: 1" = 10'
 DRAWN BY: KN
 CHECKED BY: KN
 JOB NUMBER: 17-126

MAP PREPARED BY:
 KEITH NOFIELD, PLS 7393
 LICENSE EXPIRES: 12-31-17



Steinfeld Gardens
2366 Rainbow Court, Hayward, CA. 94542
LOT 6 15AC1 NO. 3992 BOOK 126 OF MAPS PAGE 86 ALAMEDA COUNTY RECORDS

OWNERS

ASSOCIATE ARCHITECT

STRUCTURALENGINEER

CONSULTANT

[illegible]

SHEET TITLE

PROJECT NUMBER PROJECT NAME

Steinfeld

SCALE

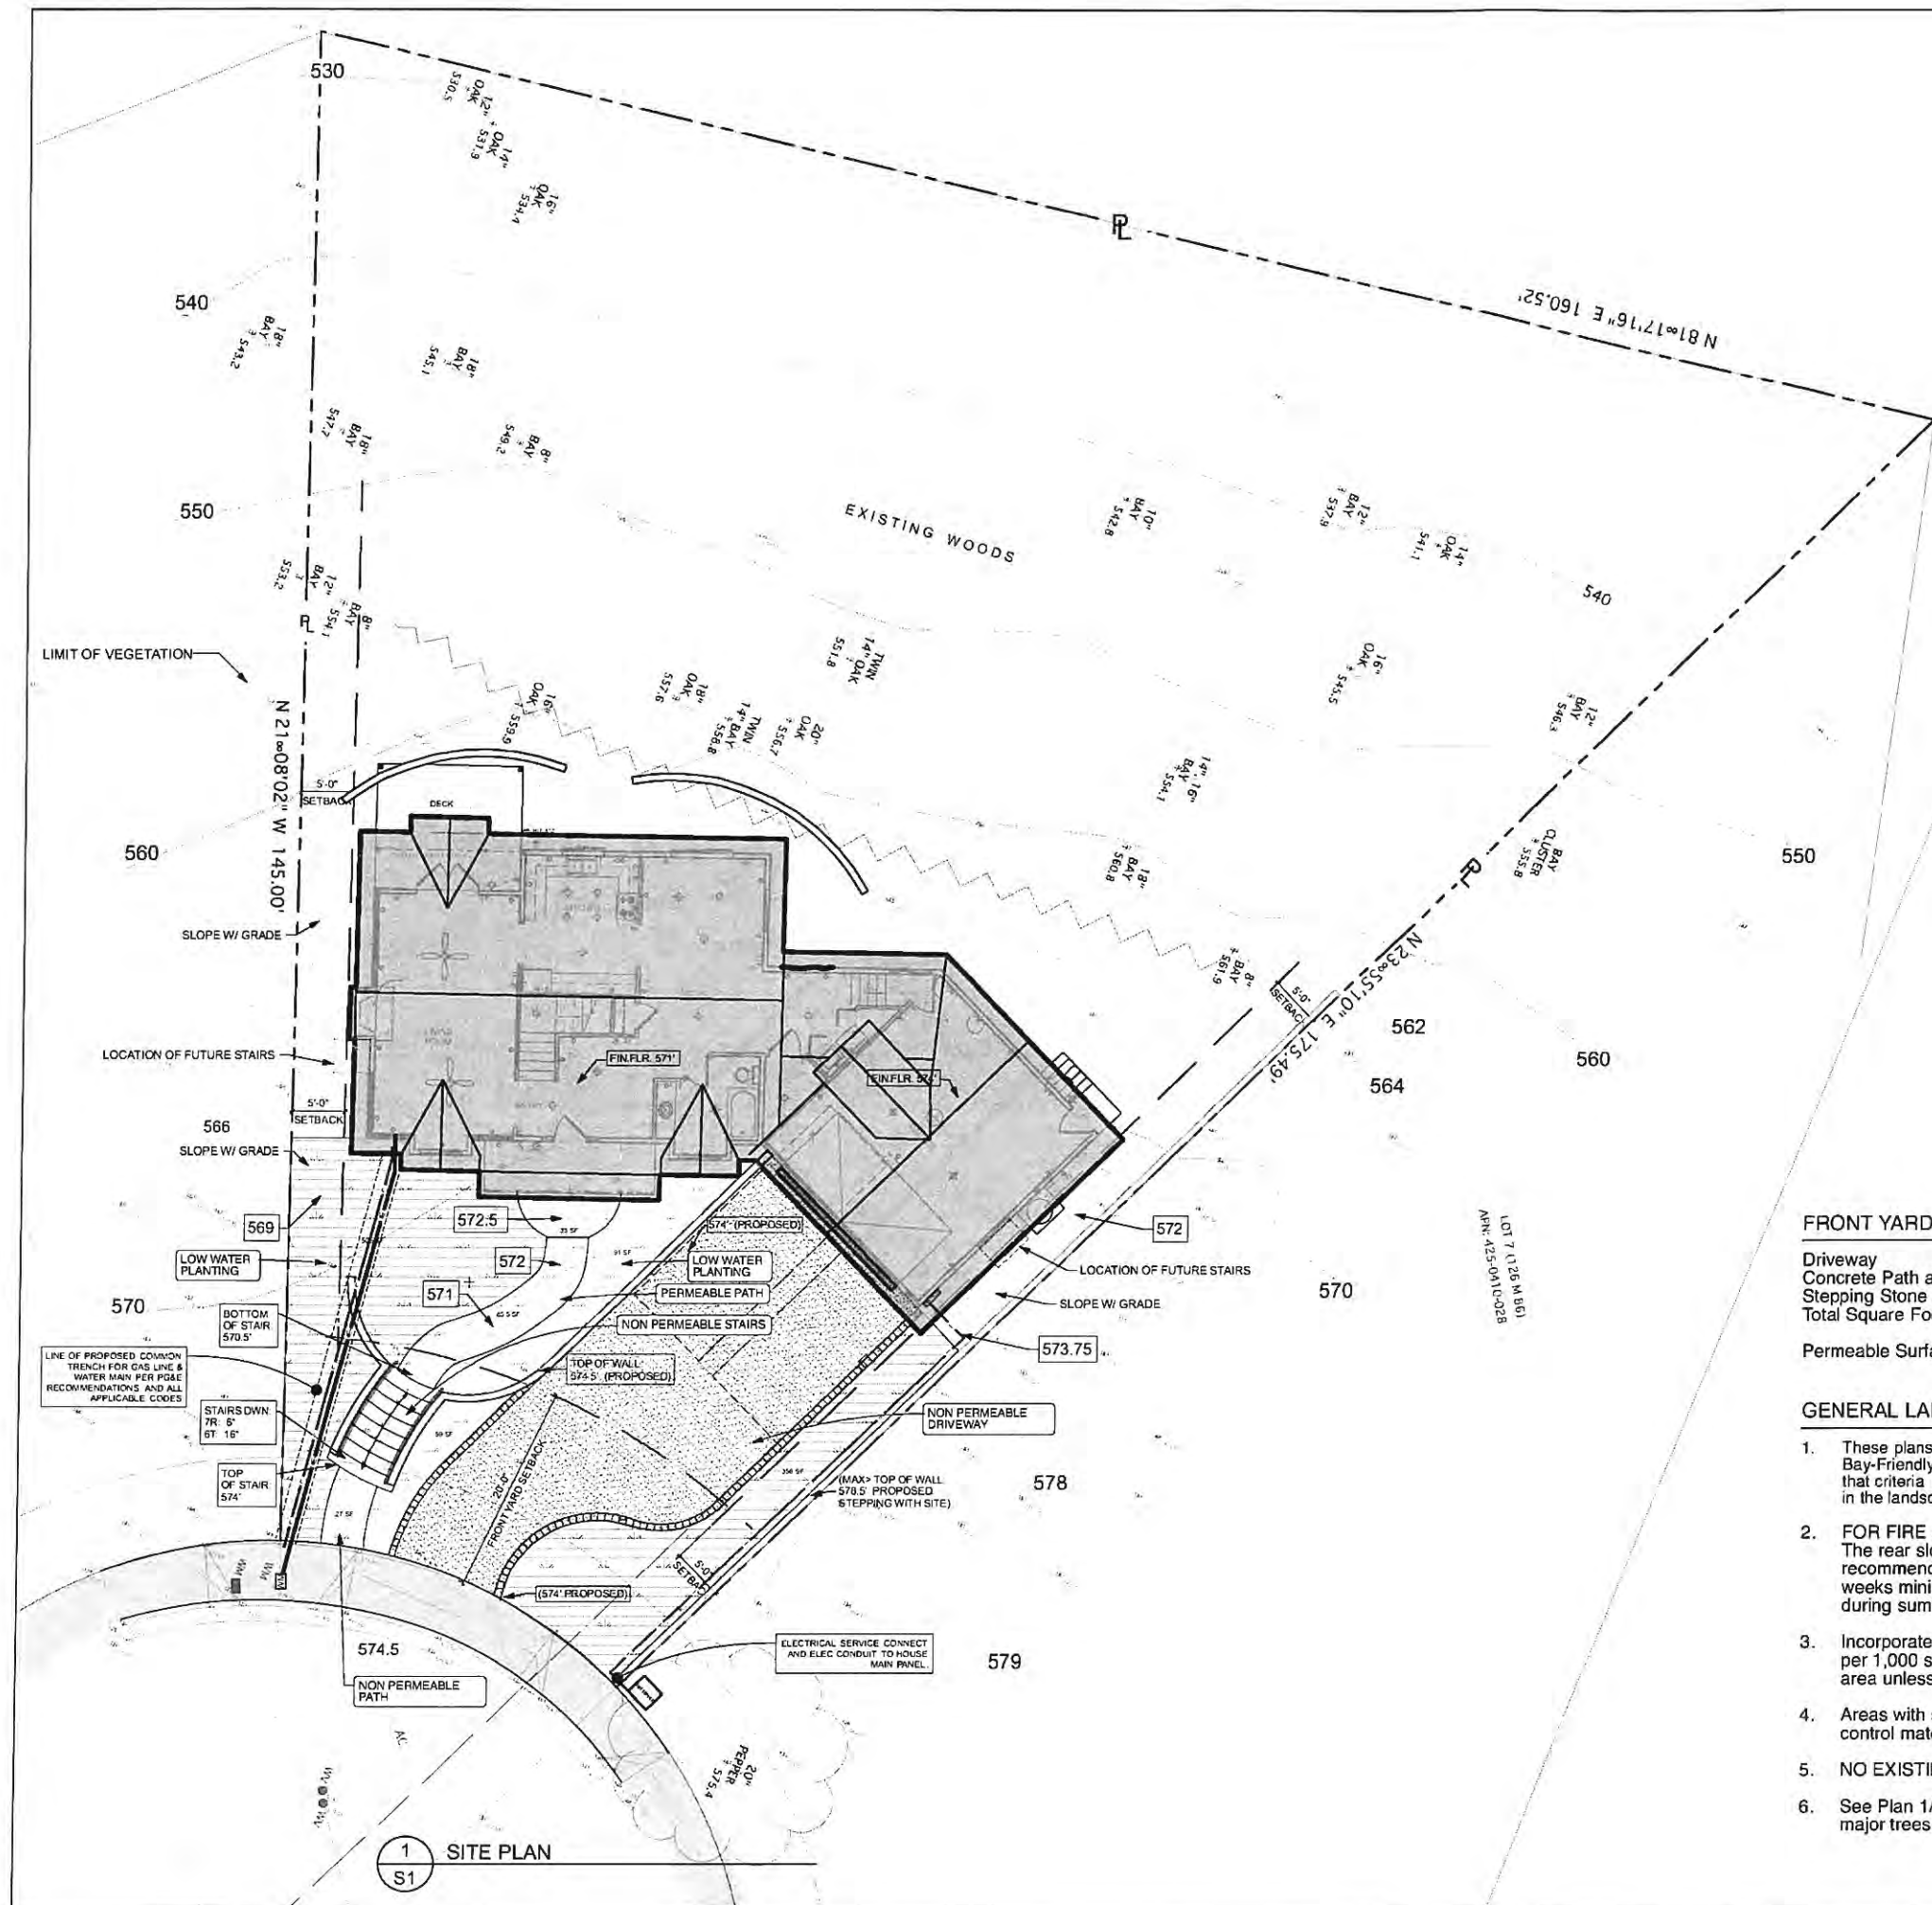
3/16 inch = 1 Foot

NORTH

SHEET NUMBER



L1



TOTAL LOT SIZE:	14,140 SQ.FT.
TOTAL FRONT YARD SIZE:	2,251 SQ.FT.
TOTAL PERMEABLE: (FRONT)	1,197 SQ.FT.
TOTAL NON PERMEABLE: (FRONT)	1,054 SQ.FT.

PERMEABILITY KEY NOTES

 PERMEABLE
 NON PERMEABLE
 CITY SIDE WALK

SYMBOLS KEY

XXX' PROPOSED GRADE
---XXX'--- EXISTING CONTOUR

KEY

PROPERTY LINE — **PL** —
BUILDING SETBACK LINE — —

FRONT YARD PERMEABLE/IMPERMEABLE SURFACES:

Driveway	Impermeable	918 Square Ft.
Concrete Path and Walls	Impermeable	136 Square Ft.
Stepping Stone Path and Planting Beds	Permeable	1,197 Square Ft.
Total Square Footage		2,251 Square Ft.

Permeable Surfaces Percentage	53 Percent
-------------------------------	------------

GENERAL LANDSCAPING NOTES

1. These plans comply with the criteria of 'City of Hayward Bay-Friendly Water Efficient Landscape Ordinance' and that criteria has been applied for the efficient use of water in the landscape and irrigation design plans.
2. **FOR FIRE SAFETY AND SUPPRESSION:**
The rear slope will be thinned as per fire zone safety recommendations the plants will be watered every three weeks minimum. The native grasses will be cut to 4" ht. during summer months.
3. Incorporate compost at the rate of at least 4 cubic yards per 1,000 square feet to a depth of 6" into the landscape area unless counter-indicated by a soil test).
4. Areas with slopes greater than 3:1 to receive erosion control material.
5. **NO EXISTING TREES WILL BE REMOVED.**
6. See Plan 1/L1 for dimensions noting distances from major trees to proposed Line of Disturbance.



PROJECT

Steinfeld Gardens2366 Rainbow Court, Hayward, CA, 94542
LOT 6 - TRACT NO. 2392 - BOOK 126 OF MAPS PAGE 86 ALAMEDA COUNTY RECORDS**LANDSCAPING PLANS**

OWNERS

Steinfeld

ASSOCIATE ARCHITECT

STRUCTURAL ENGINEER

CONSULTANT

ISSUES/REVISIONS

#	DATE	DESCRIPTION	DRAWN
2	181103		
1	181204		



PROJECT

Steinfeld Gardens2366 Rainbow Court, Hayward, CA. 94542
LOT 6, TRACT NO. 3592, BOOK 126 OF MAPS, PAGE 85 ALAMEDA COUNTY RECORDS**LANDSCAPING PLANS**

OWNERS

Steinfeld

ASSOCIATE ARCHITECT

STRUCTURAL ENGINEER

CONSULTANT

ISSUES/REVISIONS

#	DATE	DESCRIPTION	DRAWN
2	181103		
1	181204		



© COPYRIGHT 2013

"Reproduction or use of any materials herein without the written permission of Jeni Webber and Associates violates the copyright laws of the United States."

SHEET TITLE

Planting Plan

PROJECT NUMBER PROJECT NAME

Steinfeld

SCALE

3/16 inch = 1 Foot

NORTH

SHEET NUMBER

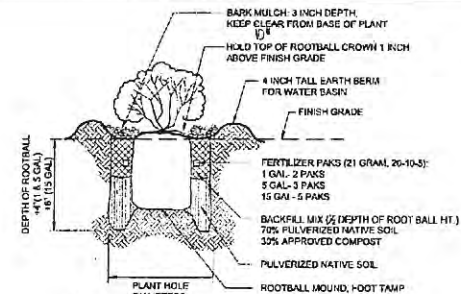
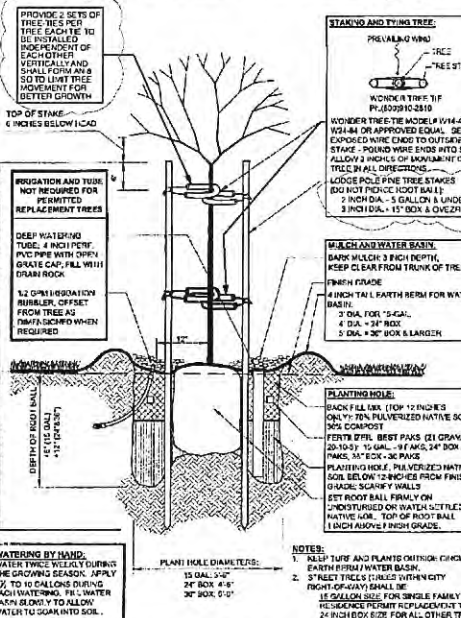
**L4**

SELECTIVELY THIN VEGETATION
AS PER FIRE MANAGEMENT REQ.
SEE SHEET L1.

LIMIT OF VEGETATION

SELECTIVELY THIN VEGETATION
AS PER FIRE MANAGEMENT REQ.
SEE SHEET L1.

LIMIT OF VEGETATION

**3 TREE PLANTING DETAIL****Steinfeld Plant List**

Symbol	SIZE	Plant	Common Name	Reference	WFO	Height	Width	Spacing
Step-ables for the Between Paviers								
DYS	flat	Dymondia m. 'Silver Carpet'	Silver Carpet Dymondia	Low	1-3"	16"-20"	20"	
Perennial								
AMI	4"	Achillea millefolium 'Island Pink'	Yarrow	Low	18"	18"	18"	
AGB	1 gal	Agapanthus 'Blue Storm'	Uly of the Nile	Moderate	2'	3'	3'	
AGR	1 gal	Agastache rupestris	Sunset Hyssop Licorice Mint	Low	36"-42"	3'	3'	
CLS	2 gal	Clivia 'Salome'	Natal Lily 'Salome'	Moderate	2'	2'	2'	
GLW	1 gal	Gaura lindheimeri 'Whirling Butterflies'	Wand Flower	Moderate	3'	3'	3'	
IRB	bulb	Iris germanica	Bearded Iris 'Black is Black'	Low	2'	1'	1'	
NMH	bulb	Narcissus 'Mount Hood'	'Mount Hood'	Very Low	1'	8"	12"	
NEW	4"	Nepeta 'Walker's Low'	'Catmint 'Walker's Low'	Low	18"-24"	18"	16"	
STB	4"	Stachys byzantina	Lamb's Ear	Low	5'	2'	2'	
THS	4"	Thymus praecox pseudolanuginosus		Low	2"	24"	24"	
Grasses and Grasslike								
FSB	4"	Festuca idahoensis 'Siskiyou Blue'	Idaho Fescue	Mod.	1-2'	1-2'	2'	
SEA	4"	Sesleria autumnalis	Moor Grass	Moderate	18"	18"	18"	
Ferns								
WOF	5 gal	Woodwardia filimbriata	Giant chain fern	Moderate	4'	3'	3'	
Sub-shrubs								
LAG	1 gal	Lavendula x intermedia 'Grosso'	Lavandins	Low	2.5'	2.5'	2.5'	
LAS	1 gal	Lavendula 'Silvery Anouk'	Spanish Lavender Silvery Anouk	Low	2'	2'	2'	
PEL	1 gal	Perovskia 'Longin'	Russian Sage	Low	3'	4'	4'	
SLQ	1 gal	Santolina neapolitana 'Lemon Queen'	Lavender Cotton	Low	2'	2-3'	2.5'	
Shrubs								
AZA	5 gal	Azalea 'Alaska'	Japanese barberry	Moderate	3'	4'	4'	
BEC	5 gal	Berberis 'Concord'	Smoke Bush	Moderate	18"	18"	18"	
BRC	5 gal	Berberis l. 'Royal Cloak'		Moderate	4'	4'	4'	
FCE	5 gal	Frangula californica 'Mound San Bruno'	Coffeeberry	Low	4'	8'	4'	
WEG	5 gal	Westringia 'Gray Box'	WEG	Low	2-3'	2-3'	3'	
Trees								
THP	24" b	Prunus c. 'Thunder Cloud'	Purple Leaved Plum	Moderate	20'	20'	20'	
Fruits								
CIM	15 gal	Citrus x meyeri 'Improved' espaliered	Improved Meyer Lemon - Standard	Moderate	8'	8'	8'	

GENERAL LANDSCAPING NOTES

1. These plans comply with the criteria of 'City of Hayward Bay-Friendly Water Efficient Landscape Ordinance' and that criteria has been applied for the efficient use of water in the landscape and irrigation design plans.

PLANTING PLAN NOTES:

- ALL PLANTED AREAS TO BE MULCHED WITH 3" DEEP ORGANIC RECYCLED CHIPPED WOOD DARK BROWN COLOR 1" DIA MAX SIZE (EXCEPTION OF THYME GROUND COVER)
- THYME GROUND COVER PLANTED AREAS TO HAVE GOLD FINE MULCH
- THE LIMITS OF VEGETATION LINE WAS NOTED ON TOPOGRAPHIC SURVEY BY KETH NOLFELD, PROFESSIONAL SURVEYING LIC. 7393 DATED 1/13/17 AND DETERMINED WITH FIELD MEASUREMENTS
- SOIL TO BE AMENDED TO A DEPTH OF 8" IN THE LANDSCAPE AREAS BASED ON SOIL FERTILITY TEST AFTER MASS GRADING. A SOIL ANALYSIS REPORT WILL BE INCLUDED FOR AMENDING THE SOIL WITH ORGANIC COMPOST TO BRING THE SOIL ORGANIC MATTER TO A MINIMUM OF 5% BY DRY WEIGHT AND INCORPORATING INORGANIC FERTILIZERS TO RECOMMENDED LEVELS FOR PLANTING AREAS. RECOMMENDED LEVELS OF 5CY PER 1000 SF IN ORDINANCE REVIEW JUNE 2015. THE SOIL ANALYSIS REPORT WILL BE ISSUED AS PART OF CERTIFICATE OF COMPLETION

KEY

PROPERTY LINE - - - - -

BUILDING SETBACK LINE - - - - -

1 PLANTING PLAN**L4**



FRONT ELEVATION

SCALE 1/4" = 1'-0"

BUILDING ADDRESS NUMBERS TO BE PROVIDED ON THE FRONT OF ALL BUILDINGS AND SHALL BE VISIBLE AND LEGIBLE FROM THE STREET FRONTING THE PROPERTY. SAID NUMBERS SHALL BE 5" MIN. AND CONTRAST WITH THE BACKGROUND.



LEFT ELEVATION

SCALE 1/4" = 1'-0"

REVISIONS	BY

PACIFIC MODERN HOMES
P.O. BOX 670
ELK GROVE, CA.
95759-9514
PHONE: (916) 685-9514



PAGE TITLE

ELEVATIONS

RESIDENCE FOR:
JOYCE STEINFELD #9422
2366 REINBOW COURT
HAYWARD, CA 94542

PRE-ENGINEERED
MANCHESTER

DATE: 5/11/18
SCALE: 1/4" = 1'-0"
DRAWN BY: HMV
PLAN NO: 9422

SHEET: 1



WINDOWS TO BE MILGARD DUAL GLAZED LOW E -
VINYL TUSCANY

REAR ELEVATION

SCALE 1/4" = 1'-0"

LANDING AT DOORS SHALL BE A MINIMUM OF
THE WIDTH OF THE DOOR, AND EXTEND IN THE
DIRECTION OF TRAVEL A MIN OF 36". A 42" HIGH
GUARDRAIL WITH NO OPENING LARGE ENOUGH FOR A
4" SPHERE TO PASS THROUGH IS REQUIRED ON
ALL LANDINGS MORE THAN 30" ABOVE THE ADJOINING
LEVEL OR GROUND. A HAND RAIL IS REQUIRED
FOR STAIRS WITH FOUR (4) OR MORE RISERS.
ALL HAND RAILS MUST BE ABLE TO WITHSTAND
200 LB LOAD AT ANY POINT ALONG ITS LENGTH.



RIGHT ELEVATION

SCALE 1/4" = 1'-0"

REVISIONS	BY

PACIFIC MODERN HOMES
P.O. BOX 670
ELK GROVE, CA.
95759-9514
PHONE: (916) 685-9514



PAGE TITLE

ELEVATIONS

RESIDENCE FOR:
JOYCE STEINFELD #9422
2366 RAINBOW COURT
HAYWARD, CA 94542

PRE-
ENGINEERED
MANCHESTER

DATE: 5/11/18
SCALE: 1/4" = 1'-0"
DRAWN BY: HV
PLAN NO: 9422

SHEET:
2

RESIDENTIAL LIGHTING REQUIREMENTS

LIGHTING CONTROLS & COMPONENTS. ALL LIGHTING CONTROL DEVICES & SYSTEMS, BALLASTS & LUMINAIRES MUST MEET THE APPLICABLE REQUIREMENTS OF 110.9.

JAB HIGH EFFICACY LIGHT SOURCES. TO QUALIFY AS A JAB HIGH EFFICACY LIGHT SOURCE FOR COMPLIANCE WITH 150.0(k), A RESIDENTIAL LIGHT SOURCE MUST BE CERTIFIED TO THE ENERGY COMMISSION ACCORDING TO THE JOINT APPENDIX JAB.

LUMINAIRE EFFICACY. ALL INSTALLED LUMINAIRES MUST BE HIGH EFFICACY IN ACCORDANCE WITH TABLE 150.0-A.

BLANK ELECTRICAL BOXES. THE NUMBER OF ELECTRICAL BOXES THAT ARE MORE THAN 5 FEET ABOVE FINISHED FLOOR & DO NOT CONTAIN A LUMINAIRE OR OTHER DEVICE MUST BE NO GREATER THAN THE NUMBER OF BEDROOMS. THESE ELECTRICAL BOXES MUST BE SERVED BY A DIMMER, VACANCY SENSOR CONTROL, OR FAN SPEED CONTROL.

RECESSED DOWNLIGHT LUMINAIRES IN CEILINGS. LUMINAIRES RECESSED INTO CEILINGS MUST MEET ALL OF THE REQUIREMENTS FOR INSULATION CONTACT, (IC) LABELING, AIR LEAKAGE, SEALING MAINTENANCE, & SOCKET & LIGHT SOURCE AS DESCRIBED IN 150.0(k) 1C. A JAB-2016-E LIGHT SOURCE RATED FOR ELEVATED TEMPERATURE MUST BE INSTALLED BY FINAL INSPECTION IN ALL RECESSED DOWN LIGHT LUMINAIRES IN CEILINGS.

ELECTRONIC BALLASTS. BALLASTS FOR FLOURESCENT LAMPS RATED 13 WATTS OR GREATER MUST BE ELECTRONIC AND MUST HAVE AN OUTPUT FREQUENCY NO LESS THAN 20KHZ.

NIGHT LIGHTS. PERMANENTLY INSTALLED NIGHT LIGHTS AND NIGHT LIGHTS INTEGRAL TO INSTALLED LUMINAIRES OR EXHAUST FANS MUST BE RATED TO CONSUME NO MORE THAN 5 WATTS OF POWER PER LUMINAIRE OR EXHAUST FAN AS DETERMINED IN ACCORDANCE WITH 130.0(c). NIGHT LIGHTS DO NOT NEED TO BE CONTROLLED BY VACANCY SENSORS.

LIGHTING INTEGRAL TO EXHAUST FANS. LIGHTING INTEGRAL TO EXHAUST FANS(EXCEPT WHEN INSTALLED BY THE MANUFACTURER IN KITCHEN EXHAUST HOODS) MUST MEET THE APPLICABLE REQUIREMENTS OF 150.0(k).

SCREW BASED LUMINAIRES. SCREW BASED LUMINAIRES MUST NOT BE RECESSED DOWNLIGHT LUMINAIRES IN CEILINGS AND MUST CONTAIN LAMPS THAT COMPLY WITH REFERENCE JOINT APPENDIX JAB. INSTALLED LAMPS MUST BE MARKED WITH "JAB-2016" OR JAB-2016-E" AS SPECIFIED IN REFERENCE JOINT APPENDIX JAB.

ENCLOSED LUMINAIRES. LIGHT SOURCES INSTALLED IN ENCLOSED LUMINAIRES MUST BE JAB COMPLIANT AND MUST BE MARKED WITH "JAB-2016-E".

INTERIOR SWITCHES AND CONTROLS. ALL FORWARD PHASE CUT DIMMERS USED WITH LED LIGHT SOURCES MUST COMPLY WITH NEMA SSL 7A. EXHAUST FANS MUST BE SWITCHED SEPARATELY FROM LIGHTING SYSTEMS.

LUMINAIRES MUST BE SWITCHED WITH READILY ACCESSIBLE CONTROLS THAT PERMIT THE LUMINAIRES TO BE MANUALLY SWITCHED ON AND OFF.

CONTROLS AND EQUIPMENT MUST BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. NO CONTROL MUST BYPASS A DIMMER OR VACANCY SENSOR FUNCTION IF THE CONTROL IS INSTALLED TO COMPLY WITH 150.0(k).

LIGHTING CONTROLS MUST COMPLY WITH THE APPLICABLE REQUIREMENTS OF 110.9. AN ENERGY MANAGEMENT CONTROL SYSTEM (EMCS) MAY BE USED TO COMPLY WITH DIMMER REQUIREMENTS IF IT FUNCTIONS AS A DIMMER ACCORDING TO 110.9; MEETS THE INSTALLATION CERTIFICATE REQUIREMENTS OF 130.4; MEETS THE EMCS REQUIREMENTS OF 130.5(f); AND MEETS ALL OTHER REQUIREMENTS IN 150.0(k).

AN EMCS MAY BE USED TO COMPLY WITH VACANCY SENSOR REQUIREMENTS IN 150.0(k) IF IT MEETS ALL OF THE FOLLOWING: IT FUNCTIONS AS A VACANCY SENSOR ACCORDING TO 110.9; THE INSTALLATION CERTIFICATE REQUIREMENTS OF 130.4; THE EMCS REQUIREMENTS OF 130.5(f); AND ALL OTHER REQUIREMENTS IN 150.0(k).

A MULTITASKING PROGRAMMABLE CONTROLLER MAY BE USED TO COMPLY WITH DIMMER REQUIREMENTS IN 150.0(k) IF IT PROVIDES THE FUNCTIONALITY OF A DIMMER ACCORDING TO 110.9, AND COMPLIES WITH ALL OTHER APPLICABLE REQUIREMENTS IN 150.0(k).

IN BATHROOMS, GARAGES, LAUNDRY ROOMS, AND UTILITY ROOMS, AT LEAST ONE LUMINAIRE IN EACH OF THESE SPACES MUST BE CONTROLLED BY A VACANCY SENSOR.

DIMMERS OR VACANCY SENSORS MUST CONTROL ALL LUMINAIRES REQUIRED TO HAVE LIGHT SOURCES COMPLIANT WITH REFERENCE JOINT APPENDIX JAB, EXCEPT LUMINAIRES IN CLOSETS LESS THAN 70 SQUARE FEET AND LUMINAIRES IN HALLWAYS.

UNDERCABINET LIGHTING MUST BE SWITCHED SEPARATELY FROM OTHER LIGHTING SYSTEMS.

RESIDENTIAL OUTDOOR LIGHTING. FOR SINGLE-FAMILY RESIDENTIAL BUILDINGS, OUTDOOR LIGHTING PERMANENTLY MOUNTED TO A RESIDENTIAL BUILDING OR TO OTHER BUILDINGS ON THE SAME LOT, MUST MEET THE REQUIREMENT IN ITEM 150.0(k)3A(OH AND OFF SWITCH) AND THE REQUIREMENTS IN EITHER ITEM 150.0(k)3A(PHOTOCELL AND MOTION SENSOR) OR ITEM 150.0(k)3A(PHOTO CONTROL AND AUTOMATIC TIME SWITCH CONTROL, ASTRONOMICAL TIME CLOCK, OR EMCS.)

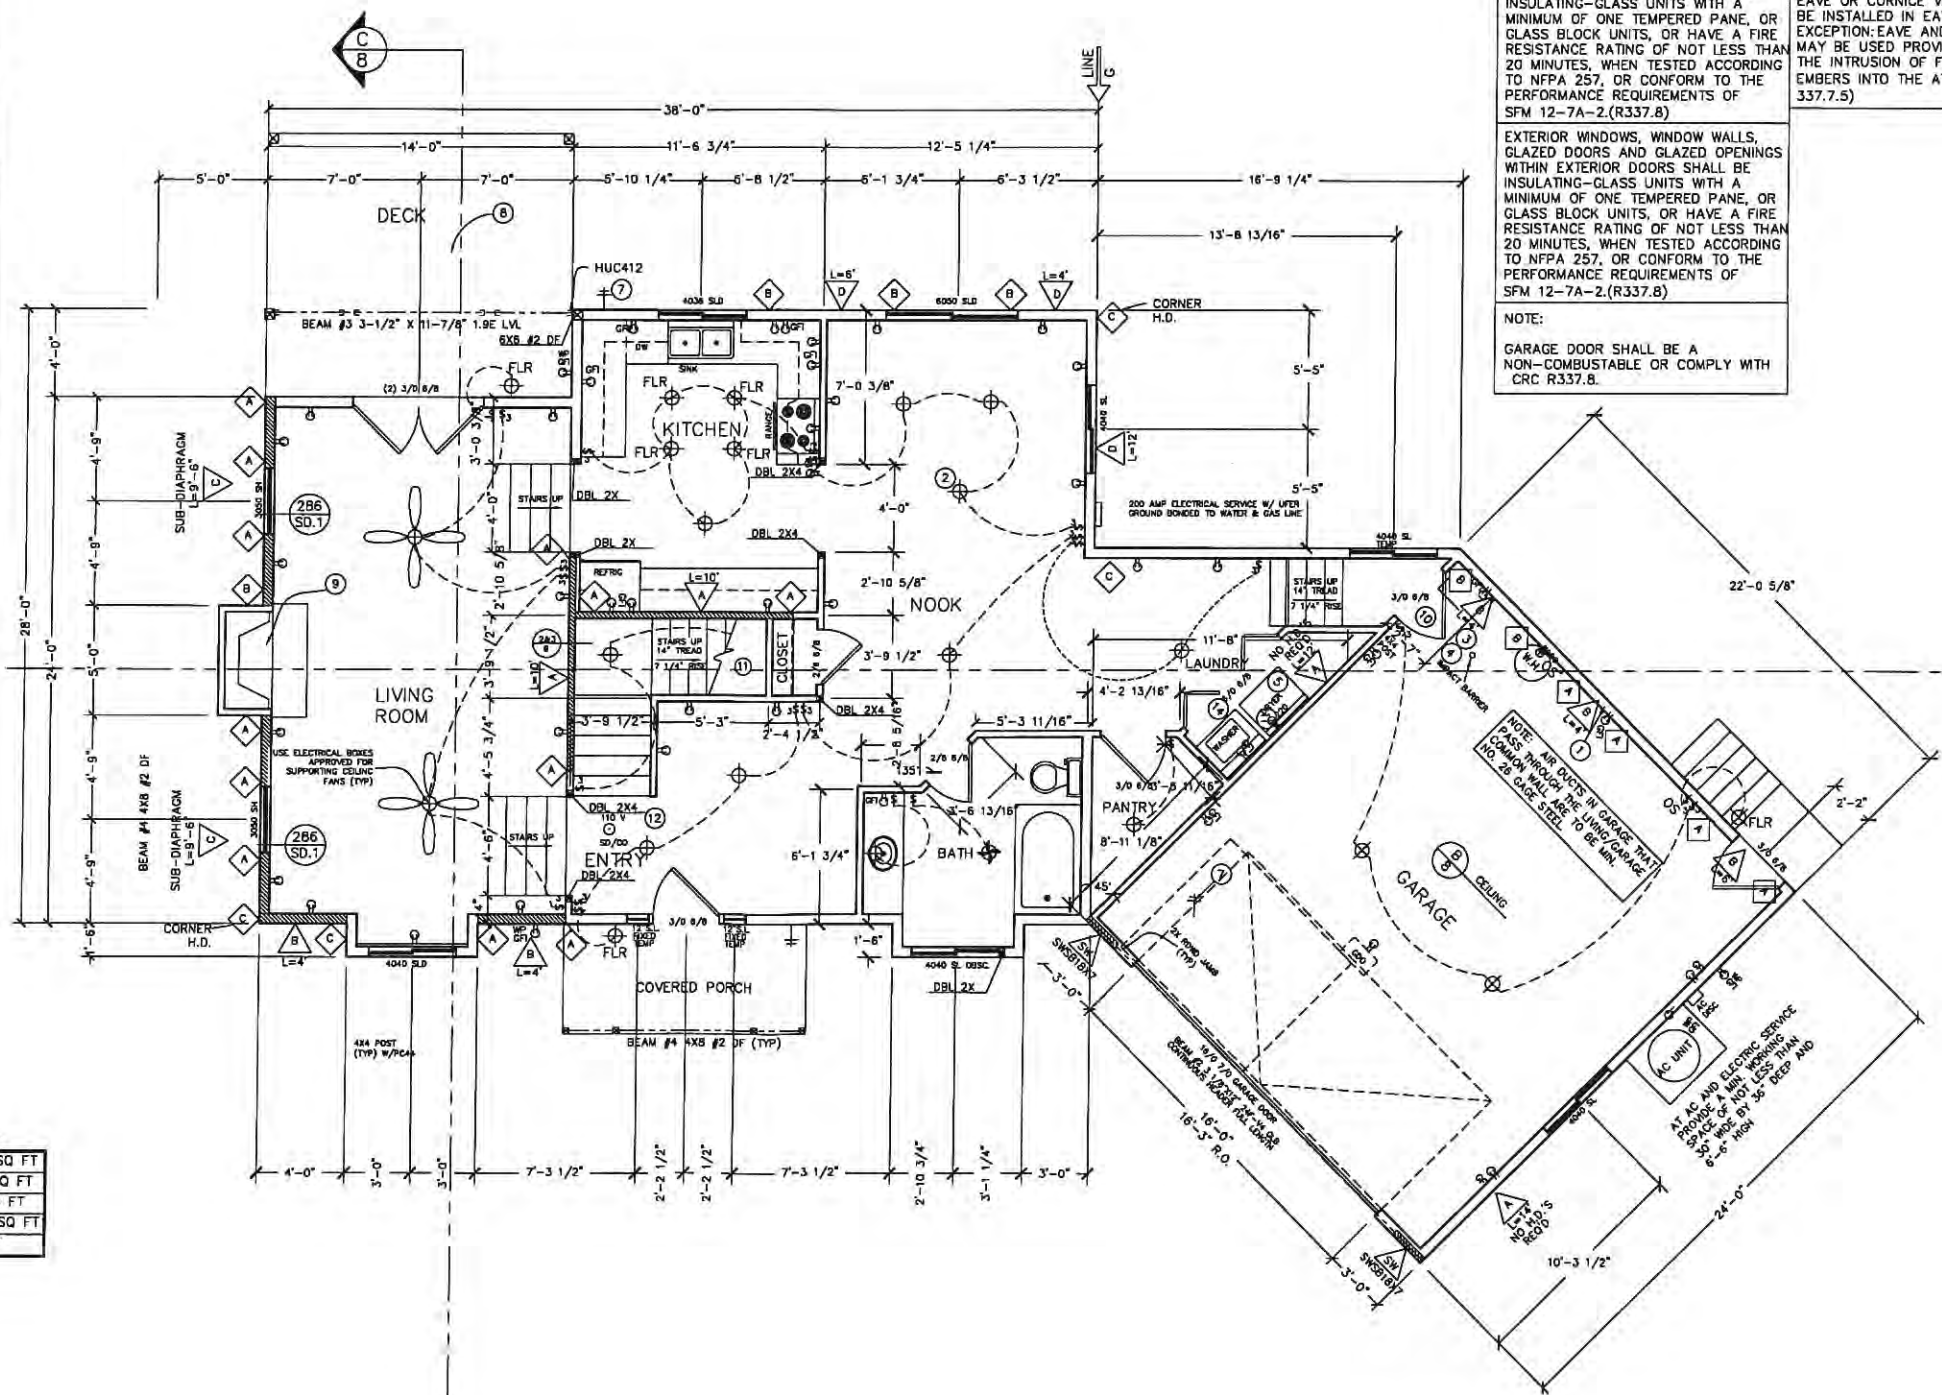
NOTE:
SEE TITLE 24 SHEETS FOR RESIDENTIAL LIGHTING REQUIREMENTS.

NOTE: ALL EGRESS WINDOWS TO HAVE MAX SILL HEIGHT OF 44 INCHES. MIN CLEAR WIDTH SHALL BE 20 INCHES. MIN CLEAR HEIGHT SHALL BE 24 INCHES. MIN OPENABLE AREA SHALL BE 5.7 SQ FT.

SAFETY GLAZING TO BE IN ALL DOORS AND ANY WINDOWS WITHIN 24 INCHES OF DOOR. ALSO IN ALL WINDOWS SILLS WITHIN 18 INCHES OF FLOOR AND 60 INCHES FROM ANY TUB OR SHOWER DRAIN.

SQUARE FOOTAGE

1ST FLOOR	1184 SQ FT
2ND FLOOR	1516 SQ FT
TOTAL LIVING	2700 SQ FT
GARAGE	528 SQ FT
CVRD PORCH	56 SQ FT



THE UNDERSIDE OF CANTILEVERED AND OVERHANGING APPENDAGES AND FLOOR PROJECTIONS SHALL MAINTAIN THE IGNITION-RESISTANT INTEGRITY OF EXTERIOR WALLS, OR THE PROJECTION SHALL BE ENCLOSED TO THE GRADE. (R337.7.6 THROUGH R337.7.9)

EXTERIOR WALLS SHALL BE APPROVED NONCOMBUSTIBLE OR IGNITION-RESISTANT MATERIAL, HEAVY TIMBER OR LOG WALL CONSTRUCTION OR SHALL PROVIDE PROTECTION FROM THE INTRUSION OF FLAMES AND EMBERS IN ACCORDANCE WITH STANDARD SFM 12-7A-1.(R337.7.3).

EXTERIOR DOOR ASSEMBLIES SHALL CONFORM TO THE PERFORMANCE REQUIREMENTS OF STANDARD SFM12-7A-1 OR SHALL BE OF APPROVED NON-COMBUSTIBLE CONSTRUCTION, OR SOLID CORE WOOD HAVING STILE AND RAILS NOT LESS THAN 1 1/2 INCHES THICK WITH INTERIOR FILL PANEL THICKNESS NO LESS THAN 1 1/2 INCHES THICK, OR SHALL HAVE A FIRE-RESISTANCE RATING OF NOT LESS THAN 20 MINUTES WHEN TESTED ACCORDING TO NFPA 252. (R337.8)

EXTERIOR WINDOWS, WINDOW WALLS, GLAZED DOORS AND GLAZED OPENINGS WITHIN EXTERIOR DOORS SHALL BE INSULATING-GLASS UNITS WITH A MINIMUM OF ONE TEMPERED PANE, OR GLASS BLOCK UNITS, OR HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 20 MINUTES, WHEN TESTED ACCORDING TO NFPA 257, OR CONFORM TO THE PERFORMANCE REQUIREMENTS OF SFM 12-7A-2.(R337.8)

EXTERIOR WINDOWS, WINDOW WALLS, GLAZED DOORS AND GLAZED OPENINGS WITHIN EXTERIOR DOORS SHALL BE INSULATING-GLASS UNITS WITH A MINIMUM OF ONE TEMPERED PANE, OR GLASS BLOCK UNITS, OR HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 20 MINUTES, WHEN TESTED ACCORDING TO NFPA 257, OR CONFORM TO THE PERFORMANCE REQUIREMENTS OF SFM 12-7A-2.(R337.8)

NOTE:
GARAGE DOOR SHALL BE A NON-COMBUSTIBLE OR COMPLY WITH CRC R337.8.

EAVE AND SOFFIT PROTECTION SHALL MEET THE REQUIREMENTS OF SFM 12-7A-3 OR SHALL BE PROTECTED BY IGNITION-RESISTANT MATERIALS OR NONCOMBUSTIBLE CONSTRUCTION ON EXPOSED UNDERSIDE.(R337.7.4 AND 337.7.5)

ROOF VALLEYS WHEN PROVIDED, VALLEY FLASHINGS SHALL NOT BE LESS THAN 0.019-INCH (0.48 MM)(NO.26 GALVANIZED SHEET GAUGE) CORROSION-RESISTANT METAL INSTALLED OVER A MINIMUM 3/8 INCH WIDE (9.14 MM) UNDERLAYMENT CONSISTING OF ONE LAYER OF NO.72 ASTM CAP SHEET RUNNING THE FULL LENGTH OF VALLEY.(R337.5)

ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER.(R337.5)

ATTIC VENTILATION IN ACCORDANCE WITH SECTION 1203, ROOF AND VENTS SHALL RESIST THE INTRUSION OF FLAME AND EMBERS INTO THE ATTIC AREA OF THE STRUCTURE, OR SHALL BE PROTECTED BY CORROSION-RESISTANT, NONCOMBUSTIBLE WIRE MESH MIN OF 1/8 INCH (1.6MM) & MAX 1/2 INCH (3.2MM) OPENINGS.(R337.6)

EAVE OR CORNICE VENTS SHALL NOT BE INSTALLED IN EAVES AND CORNICES EXCEPT: EAVE AND CORNICE VENTS MAY BE USED PROVIDED THEY RESIST THE INTRUSION OF FLAME AND BURNING EMBERS INTO THE ATTIC.(R337.7.4 AND 337.7.5)



FIRST FLOOR PLAN

RESIDENCE FOR:
JOYCE STEINFELD #9422
2366 RAINBOW COURT
HAYWARD, CA 94542

PRE-ENGINEERED
MANCHESTER

DATE: 5/11/18
SCALE: 1/4" = 1'-0"
DRAWN BY: HV
PLAN NO.: 9422
SHEET: 3

RESIDENTIAL LIGHTING REQUIREMENTS

LIGHTING CONTROLS & COMPONENTS. ALL LIGHTING CONTROL DEVICES & SYSTEMS, BALLASTS & LUMINAIRES MUST MEET THE APPLICABLE REQUIREMENTS OF 110.9

JAB HIGH EFFICACY LIGHT SOURCES. TO QUALIFY AS A JAB HIGH EFFICACY LIGHT SOURCE FOR COMPLIANCE WITH 150.0(k), A RESIDENTIAL LIGHT SOURCE MUST BE CERTIFIED TO THE ENERGY COMMISSION ACCORDING TO THE JOINT APPENDIX JAB.

LUMINAIRE EFFICACY. ALL INSTALLED LUMINAIRES MUST BE HIGH EFFICACY IN ACCORDANCE WITH TABLE 150.0-A.

BLANK ELECTRICAL BOXES. THE NUMBER OF ELECTRICAL BOXES THAT ARE MORE THAN 5 FEET ABOVE FINISHED FLOOR & DO NOT CONTAIN A LUMINAIRE OR OTHER DEVICE MUST BE NO GREATER THAN THE NUMBER OF BEDROOMS. THESE ELECTRICAL BOXES MUST BE SERVED BY A DIMMER, VACANCY SENSOR CONTROL, OR FAN SPEED CONTROL.

RECESSED DOWNLIGHT LUMINAIRES IN CEILINGS. LUMINAIRES RECESSED INTO CEILINGS MUST MEET ALL OF THE REQUIREMENTS FOR INSULATION CONTACT, (IC) LABELING, AIR LEAKAGE, SEALING MAINTENANCE, & SOCKET & LIGHT SOURCE AS DESCRIBED IN 150.0(k) (1). A JAB-2016-E LIGHT SOURCE RATED FOR ELEVATED TEMPERATURE MUST BE INSTALLED BY FINAL INSPECTION IN ALL RECESSED DOWN LIGHT LUMINAIRES IN CEILINGS.

ELECTRONIC BALLASTS. BALLASTS FOR FLOURESCENT LAMPS RATED 13 WATTS OR GREATER MUST BE ELECTRONIC AND MUST HAVE AN OUTPUT FREQUENCY NO LESS THAN 20KHZ.

NIGHT LIGHTS. PERMANENTLY INSTALLED NIGHT LIGHTS AND NIGHT LIGHTS INTEGRAL TO INSTALLED LUMINAIRES OR EXHAUST FANS MUST BE RATED TO CONSUME NO MORE THAN 5 WATTS OF POWER PER LUMINAIRE OR EXHAUST FAN AS DETERMINED IN ACCORDANCE WITH 130.0(c). NIGHT LIGHTS DO NOT NEED TO BE CONTROLLED BY VACANCY SENSORS.

LIGHTING INTEGRAL TO EXHAUST FANS. LIGHTING INTEGRAL TO EXHAUST FANS (EXCEPT WHEN INSTALLED BY THE MANUFACTURER IN KITCHEN EXHAUST HOODS) MUST MEET THE APPLICABLE REQUIREMENTS OF 150.0(k).

SCREW BASED LUMINAIRES. SCREW BASED LUMINAIRES MUST NOT BE RECESSED DOWNLIGHT LUMINAIRES IN CEILINGS AND MUST CONTAIN LAMPS THAT COMPLY WITH REFERENCE JOINT APPENDIX JAB. INSTALLED LAMPS MUST BE MARKED WITH "JAB-2016" OR JAB-2016-E" AS SPECIFIED IN REFERENCE JOINT APPENDIX JAB.

ENCLOSED LUMINAIRES. LIGHT SOURCES INSTALLED IN ENCLOSED LUMINAIRES MUST BE JAB COMPLIANT AND MUST BE MARKED WITH "JAB-2016-E".

INTERIOR SWITCHES AND CONTROLS. ALL FORWARD PHASE CUT DIMMERS USED WITH LED LIGHT SOURCES MUST COMPLY WITH NEMA SSL 7A. EXHAUST FANS MUST BE SWITCHED SEPARATELY FROM LIGHTING SYSTEMS. LUMINAIRES MUST BE SWITCHED WITH READILY ACCESSIBLE CONTROLS THAT PERMIT THE LUMINAIRES TO BE MANUALLY SWITCHED ON AND OFF.

CONTROLS AND EQUIPMENT MUST BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. NO CONTROL MUST BYPASS A DIMMER OR VACANCY SENSOR FUNCTION IF THE CONTROL IS INSTALLED TO COMPLY WITH 150.0(k).

LIGHTING CONTROLS MUST COMPLY WITH THE APPLICABLE REQUIREMENTS OF 110.9. AN ENERGY MANAGEMENT CONTROL SYSTEM (EMCS) MAY BE USED TO COMPLY WITH DIMMER REQUIREMENTS IF IT FUNCTIONS AS A DIMMER ACCORDING TO 110.9; MEETS THE INSTALLATION CERTIFICATE REQUIREMENTS OF 130.4; MEETS THE EMCS REQUIREMENTS OF 130.5(i); AND MEETS ALL OTHER REQUIREMENTS IN 150.0(k)2.

AN EMCS MAY BE USED TO COMPLY WITH VACANCY SENSOR REQUIREMENTS IN 150.0(k) IF IT MEETS ALL OF THE FOLLOWING: IT FUNCTIONS AS A VACANCY SENSOR ACCORDING TO 110.9; THE INSTALLATION CERTIFICATE REQUIREMENTS OF 130.4; THE EMCS REQUIREMENTS OF 130.5(i); AND ALL OTHER REQUIREMENTS IN 150.0(k)2.

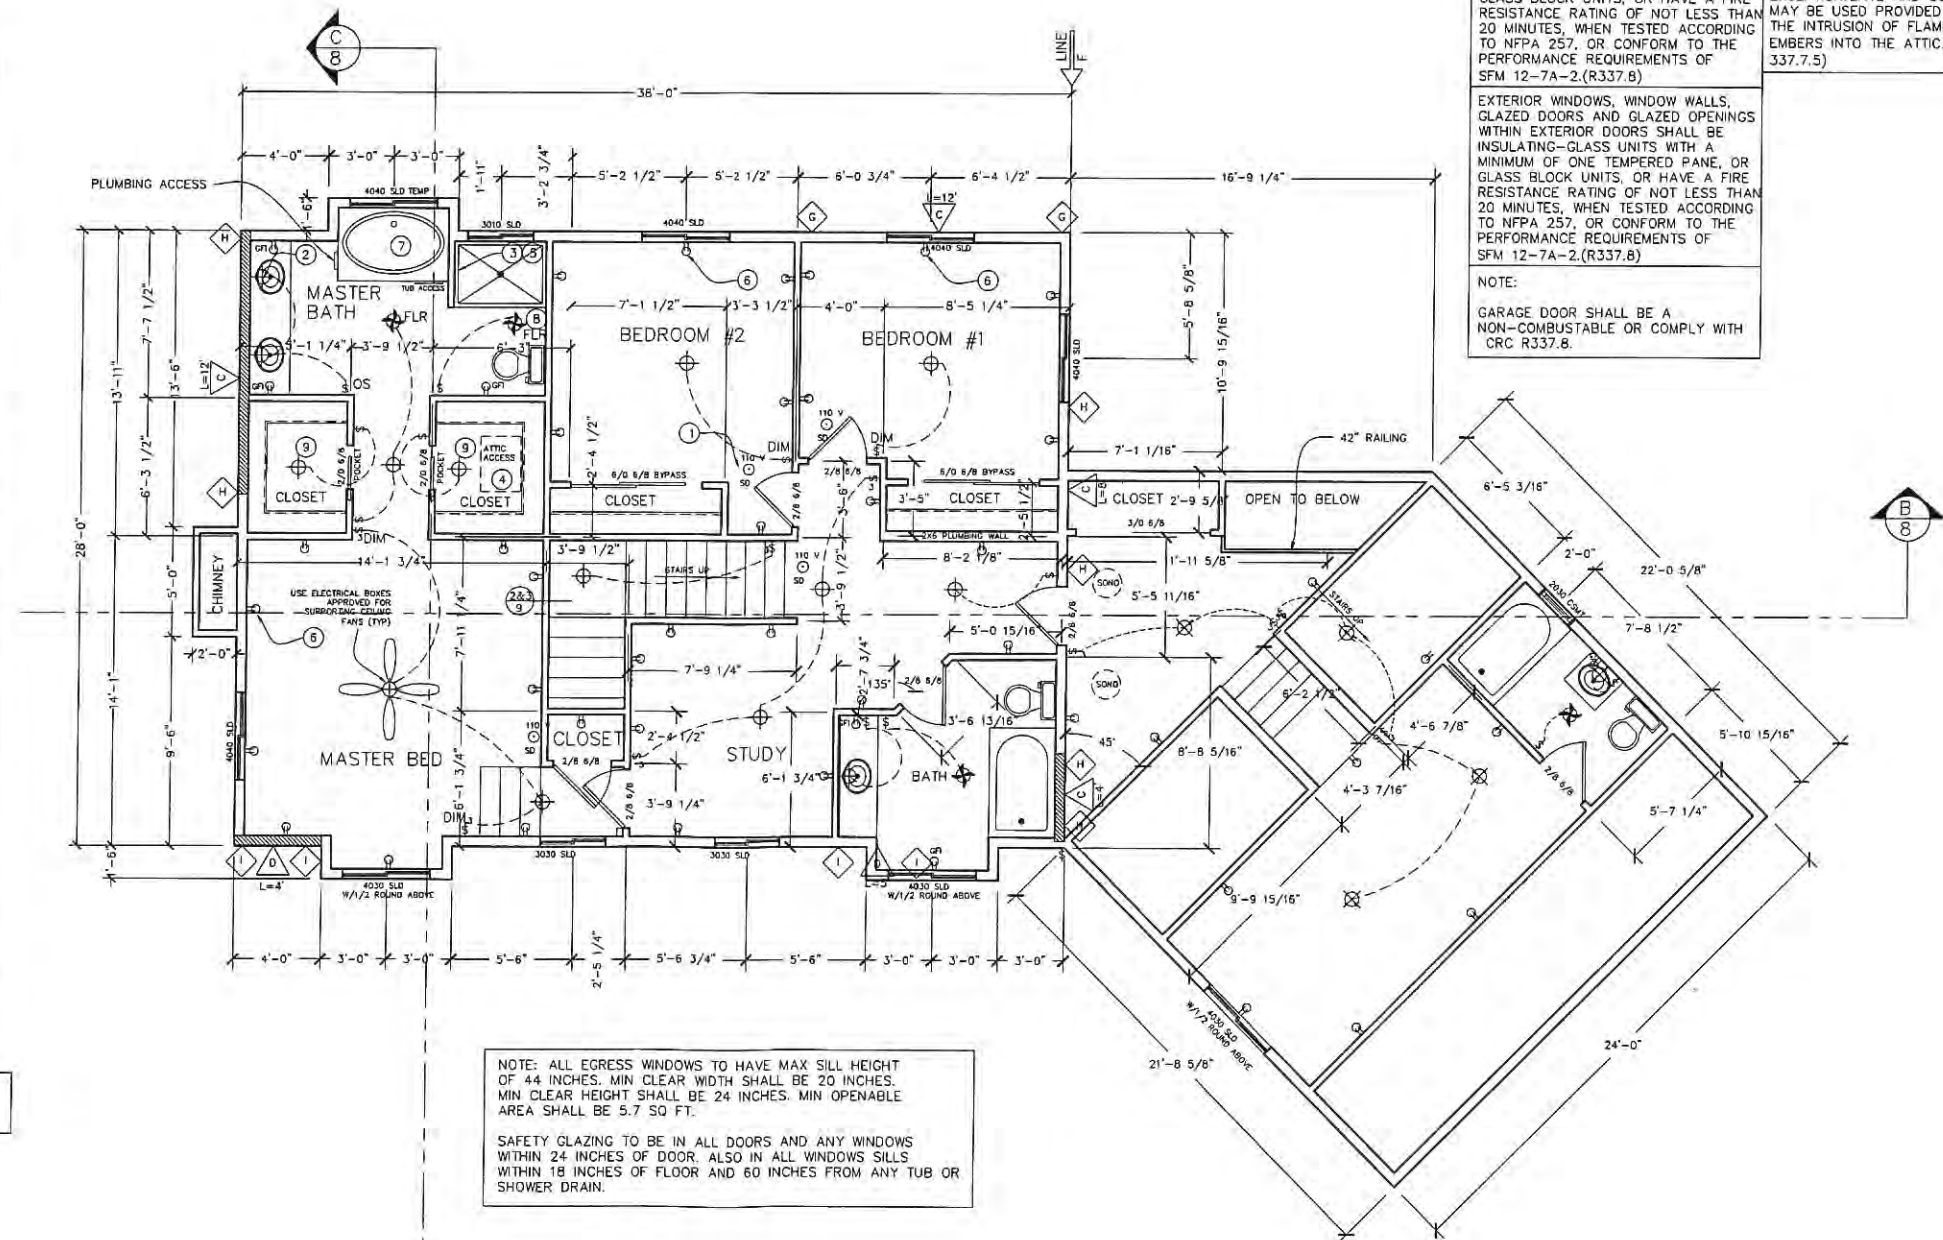
A MULTISCENE PROGRAMMABLE CONTROLLER MAY BE USED TO COMPLY WITH DIMMER REQUIREMENTS IN 150.0(k) IF IT PROVIDES THE FUNCTIONALITY OF A DIMMER ACCORDING TO 110.9, AND COMPLIES WITH ALL OTHER APPLICABLE REQUIREMENTS IN 150.0(k)2.

IN BATHROOMS, GARAGES, LAUNDRY ROOMS, AND UTILITY ROOMS, AT LEAST ONE LUMINAIRE IN EACH OF THESE SPACES MUST BE CONTROLLED BY A VACANCY SENSOR. DIMMERS OR VACANCY SENSORS MUST CONTROL ALL LUMINAIRES REQUIRED TO HAVE LIGHT SOURCES COMPLIANT WITH REFERENCE JOINT APPENDIX JAB, EXCEPT LUMINAIRES IN CLOSETS LESS THAN 70 SQUARE FEET AND LUMINAIRES IN HALLWAYS.

UNDERCABINET LIGHTING MUST BE SWITCHED SEPARATELY FROM OTHER LIGHTING SYSTEMS.

RESIDENTIAL OUTDOOR LIGHTING. FOR SINGLE-FAMILY RESIDENTIAL BUILDINGS, OUTDOOR LIGHTING PERMANENTLY MOUNTED TO A RESIDENTIAL BUILDING OR TO OTHER BUILDINGS ON THE SAME LOT, MUST MEET THE REQUIREMENT IN ITEM 150.0(k)3A(ON AND OFF SWITCH) AND THE REQUIREMENTS IN EITHER ITEM 150.0(k)3A(II)(PHOTOCELL AND MOTION SENSOR) OR ITEM 150.0(k)3A(III)(PHOTO CONTROL AND AUTOMATIC TIME SWITCH CONTROL, ASTRONOMICAL TIME CLOCK, OR EMCS.)

NOTE:
SEE TITLE 24 SHEETS FOR RESIDENTIAL LIGHTING REQUIREMENTS.



THE UNDERSIDE OF CANTILEVERED AND OVERHANGING APPENDAGES AND FLOOR PROJECTIONS SHALL MAINTAIN THE IGNITION-RESISTANT INTEGRITY OF EXTERIOR WALLS, OR THE PROJECTION SHALL BE ENCLOSED TO THE GRADE. (R337.7.6 THROUGH R337.7.9)

EXTERIOR WALLS SHALL BE APPROVED NONCOMBUSTIBLE OR IGNITION-RESISTANT MATERIAL, HEAVY TIMBER OR LOG WALL CONSTRUCTION OR SHALL PROVIDE PROTECTION FROM THE INTRUSION OF FLAMES AND EMBERS IN ACCORDANCE WITH STANDARD SFM 12-7A-1.(R337.7.3).

EXTERIOR DOOR ASSEMBLIES SHALL CONFORM TO THE PERFORMANCE REQUIREMENTS OF STANDARD SFM12-7A-1 OR SHALL BE OF APPROVED NON-COMBUSTIBLE CONSTRUCTION, OR SOLID CORE WOOD HAVING STILE AND RAILS NOT LESS THAN 1 1/2 INCHES THICK WITH INTERIOR FIELD PANEL THICKNESS NO LESS THAN 1 1/2 INCHES THICK, OR SHALL HAVE A FIRE-RESISTANCE RATING OF NOT LESS THAN 20 MINUTES WHEN TESTED ACCORDING TO NFPA 252. (R337.8)

EXTERIOR WINDOWS, WINDOW WALLS, GLAZED DOORS AND GLAZED OPENINGS WITHIN EXTERIOR DOORS SHALL BE INSULATING-GLASS UNITS WITH A MINIMUM OF ONE TEMPERED PANE, OR GLASS BLOCK UNITS, OR HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 20 MINUTES, WHEN TESTED ACCORDING TO NFPA 257, OR CONFORM TO THE PERFORMANCE REQUIREMENTS OF SFM 12-7A-2.(R337.8)

EXTERIOR WINDOWS, WINDOW WALLS, GLAZED DOORS AND GLAZED OPENINGS WITHIN EXTERIOR DOORS SHALL BE INSULATING-GLASS UNITS WITH A MINIMUM OF ONE TEMPERED PANE, OR GLASS BLOCK UNITS, OR HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 20 MINUTES, WHEN TESTED ACCORDING TO NFPA 257, OR CONFORM TO THE PERFORMANCE REQUIREMENTS OF SFM 12-7A-2.(R337.8)

NOTE:

GARAGE DOOR SHALL BE A NON-COMBUSTIBLE OR COMPLY WITH CRC R337.8.

EAVE AND SOFFIT PROTECTION SHALL MEET THE REQUIREMENTS OF SFM 12-7A-3 OR SHALL BE PROTECTED BY IGNITION-RESISTANT MATERIALS OR NONCOMBUSTIBLE CONSTRUCTION ON EXPOSED UNDERSIDE.(R337.7.4 AND 337.7.5)

ROOF VALLEYS WHEN PROVIDED, VALLEY FLASHINGS SHALL NOT BE LESS THAN 0.019-INCH (0.48 MM)(NO.26 GALVANIZED SHEET GAUGE) CORROSION-RESISTANT METAL INSTALLED OVER A MINIMUM 36 INCH WIDE (914 MM) UNDERLAYMENT CONSISTING OF ONE LAYER OF NO.72 ASTM CAP SHEET RUNNING THE FULL LENGTH OF VALLEY.(R337.5)

ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER.(R337.5)

ATTIC VENTILATION IN ACCORDANCE WITH SECTION 1203, ROOF AND VENTS SHALL RESIST THE INTRUSION OF FLAME AND EMBERS INTO THE ATTIC AREA OF THE STRUCTURE, OR SHALL BE PROTECTED BY CORROSION-RESISTANT, NONCOMBUSTIBLE WIRE MESH MIN OF 1/8 INCH (1.6MM) & MAX 1/2 INCH (3.2MM) OPENINGS.(R337.6)

EAVE OR CORNICE VENTS SHALL NOT BE INSTALLED IN EAVES AND CORNICES EXCEPT: EAVE AND CORNICE VENTS MAY BE USED PROVIDED THEY RESIST THE INTRUSION OF FLAME AND BURNING EMBERS INTO THE ATTIC.(R337.7.4 AND 337.7.5)



SECOND FLOOR PLAN

RESIDENCE FOR
JOYCE STEINFELD #9422
2366 RAINBOW COURT
HAYWARD, CA 94542

PRE-ENGINEERED
MANCHESTER

DATE: 5/11/18

SCALE: 1/4" = 1'-0"

DRAWN BY: HV

PLAN NO.: 9422

SHEET: 4