

PACIFIC MODERN HOMES
P.O. BOX 670
ELK GROVE, CA. 95759
PHONE: (916) 685-9514



COVER SHEET


PRE-ENGINEERED MANCHESTER
JOYCE STEINFELD
2366 RAINBOW COURT
HAYWARD, CA 94542
#9422

DATE:	5/11/78
SCALE:	N.T.S.
DRAWN BY:	HV
PLANT NO.:	9422
SHEET:	CS

OCCUPANCY GROUP R-3/U TYPE OF CONSTRUCTION V-B

LEGEND:

—	SUBJECT PROPERTY LINE
—	PROPERTY LINE
---	2' CONTOUR LINE
---	10' CONTOUR LINE
SS	SANITARY SEWER
~~~~~	LIMITS OF HEAVY VEGETATION/TREES
⊙	STANDARD CITY STREET MONUMENT
AC	ASPHALT CONCRETE
ACP	AGGREGATE CONCRETE PIPE
EL	ELEVATION
⊕	FIRE HYDRANT
INV.	INVERT
S.F.	SQUARE FEET
SSMH	SANITARY SEWER HANHOLE
VCP	VETRIFIED CLAY PIPE
WM	WATER METER
• WV	WATER VALVE
12"	TREE DIAMETER (SPECIES SPECIFIED)
CONCRETE	CONCRETE

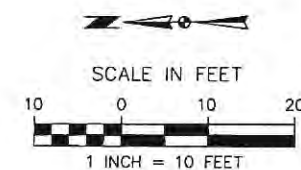**NOTES**


1. UTILITY LOCATIONS ARE ONLY APPROXIMATE AND NOT INTENDED FOR USE WITH CONSTRUCTION. INFORMATION WAS ACQUIRED FROM A FIELD SURVEY. CONTACT "USA" AT 1-800-642-2440 FOR ASSISTANCE WITH LOCATION OF UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION.
2. ALL DISTANCE AND DIMENSIONS ARE IN FEET AND DECIMALS THEREOF.
3. THE TOTAL AREA OF THE SUBJECT PROPERTY IS 14,139± S.F.
4. FEMA FLOOD ZONE (ZONE X - UNSHADED) AREAS DETERMINED TO BE OUTSIDE THE 0.2% ANNUAL CHANCE FLOODPLAIN.
5. ADDRESS OF SUBJECT SITE IS: 2366 RAINBOW COURT
6. SITE REPRODUCTION OF THIS MAP WITH OUT MY PROFESSIONAL LAND SURVEYOR'S SEAL AND SIGNATURE, IS NOT CONSIDERED AN ORIGINAL

**BASIS OF BEARINGS:**

THE BEARING OF N 35°45'24" W, FOR THE MONUMENT LINE OF RAINBOW COURT, ESTABLISHED FROM THE FOUND STREET MONUMENTS IN RAINBOW COURT, AS SHOWN ON THAT CERTAIN MAP ENTITLED "TRACT NO. 3992" FILED IN BOOK 126 OF MAPS, AT PAGE 86, WAS USED AS THE BASIS FOR THIS MAP.

**BENCHMARK:**

A TEMPORARY BENCHMARK "TBM" WITH THE ELEVATION OF 573.47' (NAVD 88 DATUM) WAS ESTABLISHED BY GPS METHODS, ON THE TOP OF A STANDARD CITY OF HAYWARD BRASS DISK IN MONUMENT WELL AT THE CENTER OF CUL-DE-SAC OF RAINBOW COURT.

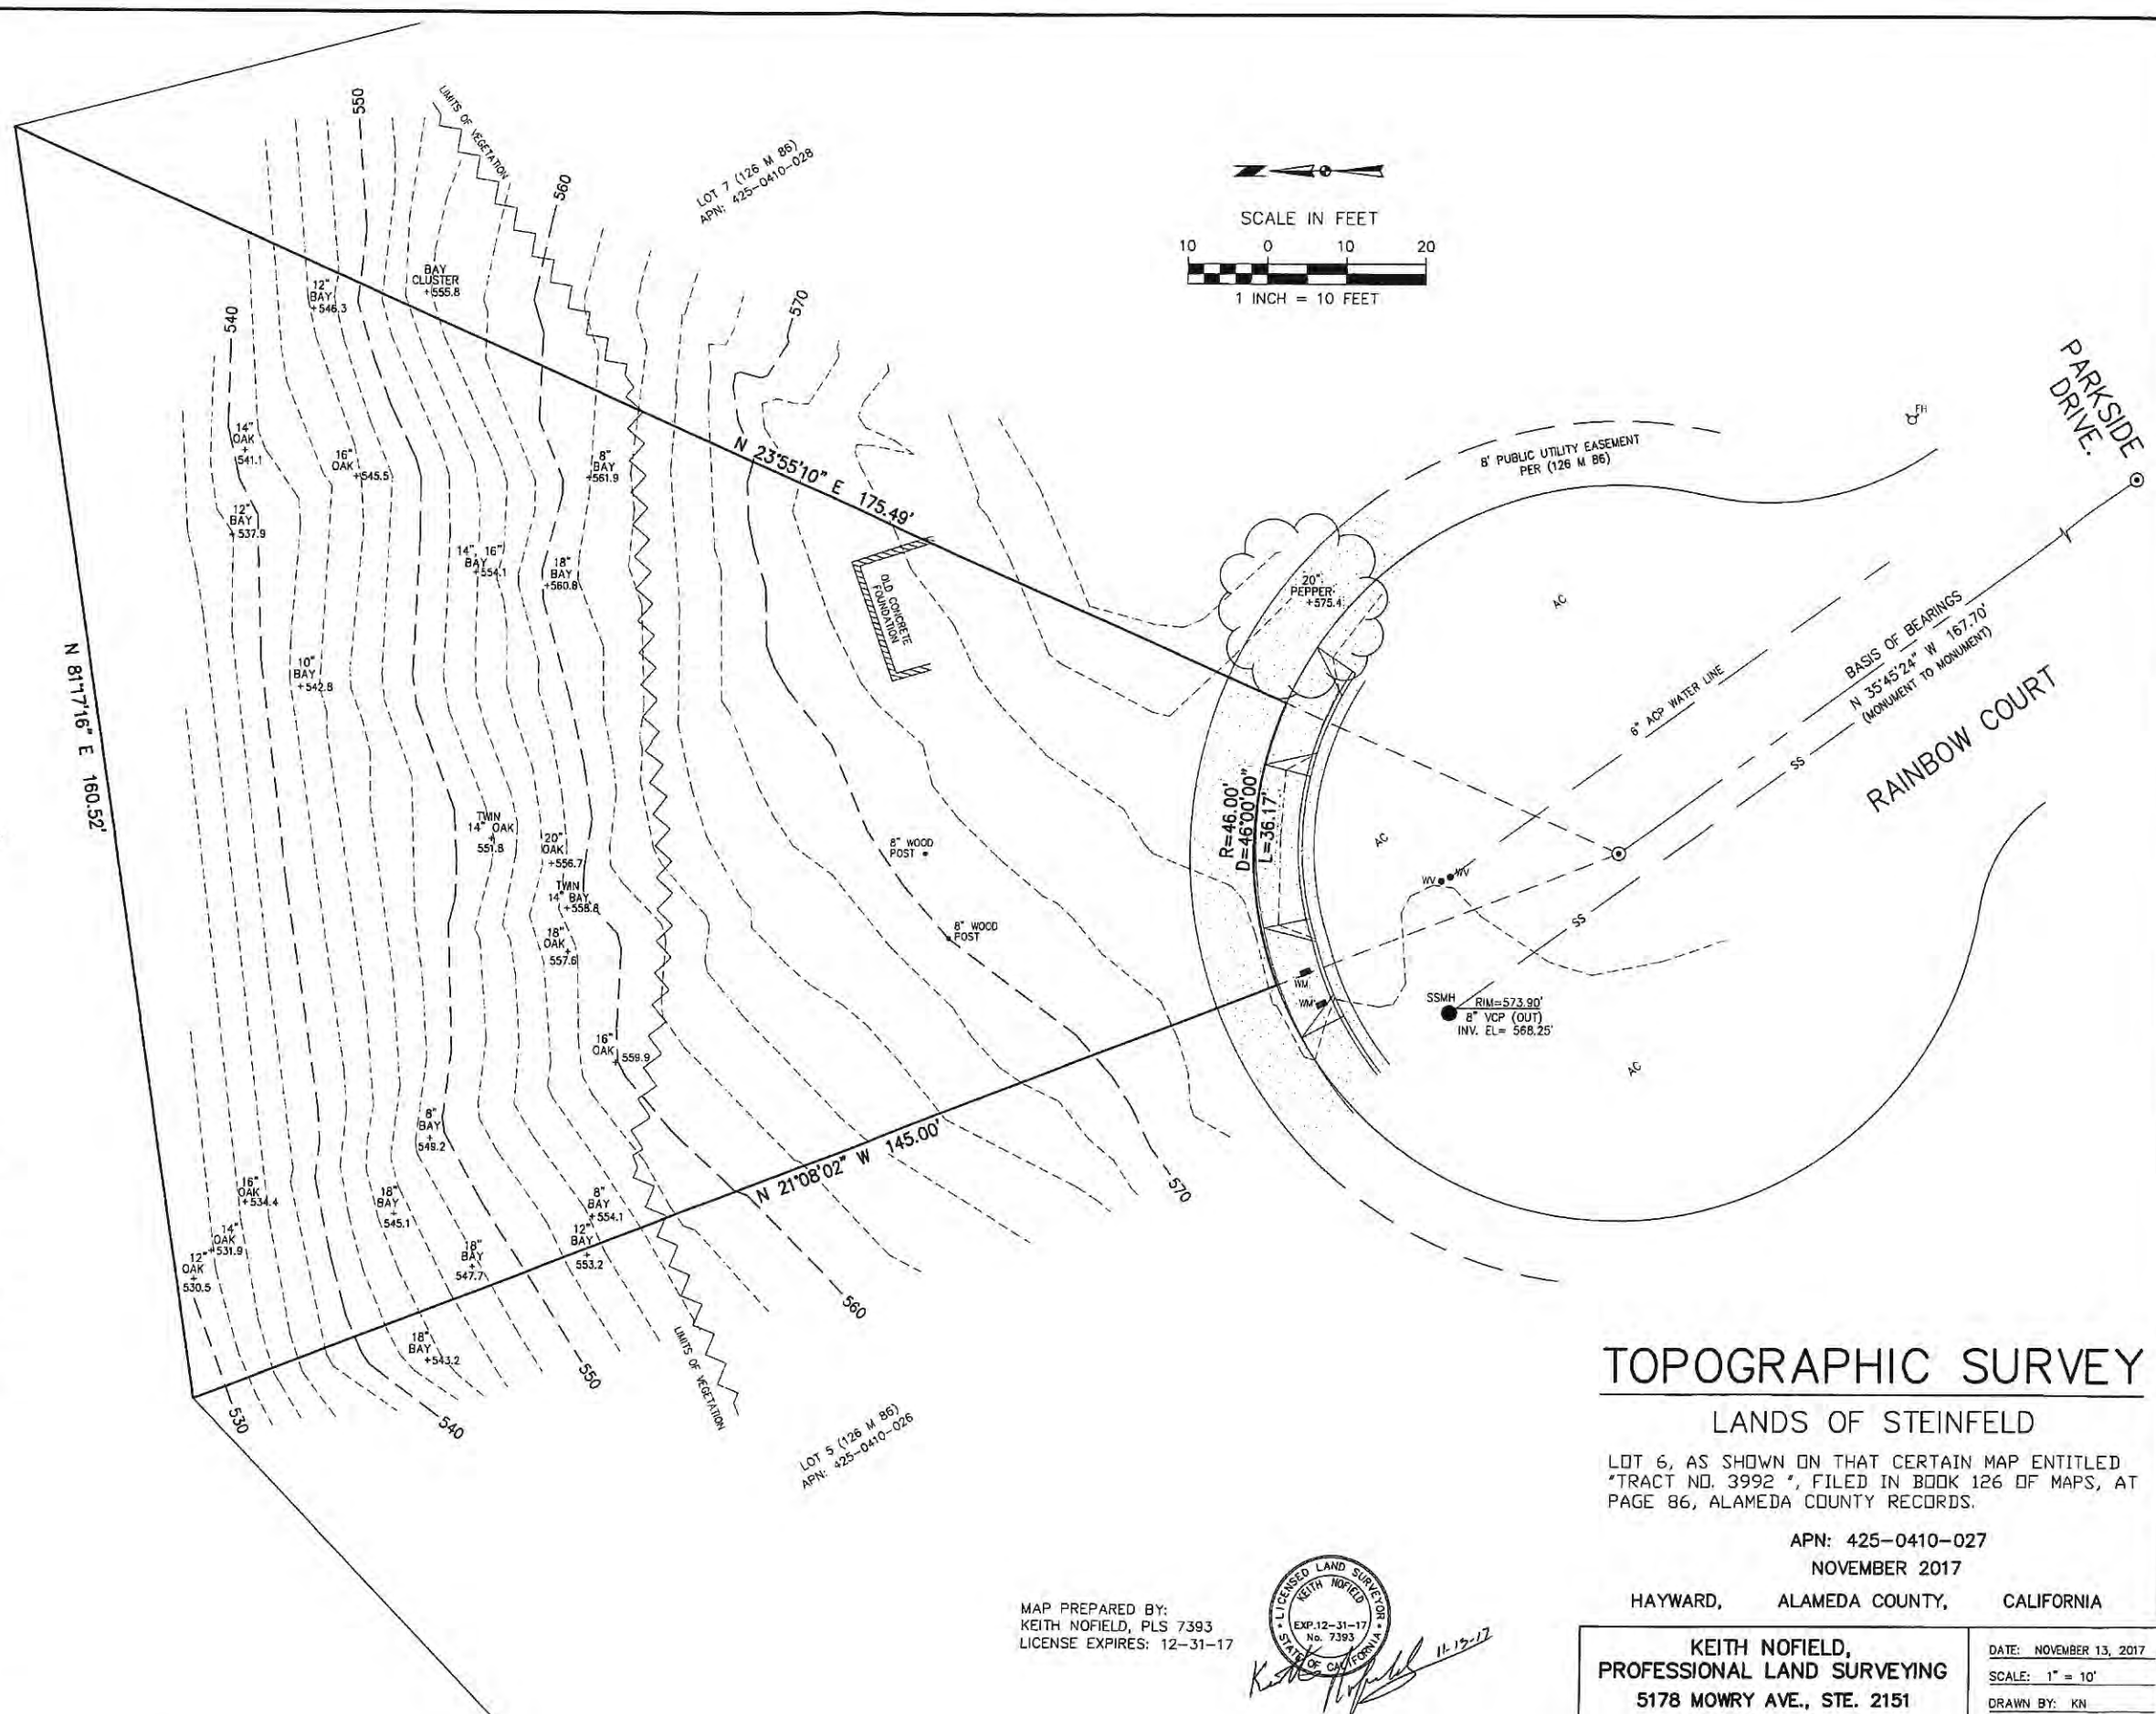**TOPOGRAPHIC SURVEY****LANDS OF STEINFELD**

LOT 6, AS SHOWN ON THAT CERTAIN MAP ENTITLED "TRACT NO. 3992", FILED IN BOOK 126 OF MAPS, AT PAGE 86, ALAMEDA COUNTY RECORDS.

APN: 425-0410-027

NOVEMBER 2017

HAYWARD, ALAMEDA COUNTY, CALIFORNIA

**KEITH NOFIELD,**  
**PROFESSIONAL LAND SURVEYING**  
 5178 MOWRY AVE., STE. 2151  
 FREMONT, CA 94538  
 510/468-2703

DATE: NOVEMBER 13, 2017  
 SCALE: 1" = 10'  
 DRAWN BY: KN  
 CHECKED BY: KN  
 JOB NUMBER: 17-126

MAP PREPARED BY:  
 KEITH NOFIELD, PLS 7393  
 LICENSE EXPIRES: 12-31-17



PROJECT

2366 Rainbow Court, Hayward, CA. 94542  
LOT 6 TRACT NO 3992 BOOK 126 OF MAPS PAGE 86 ALAMEDA COUNTY RECORDS


## OWNERS

Steinfeld

ASSOCIATE ARCHITECT

STRUCTURAL ENGINEER

CONSULTANT

[illegible]

© COPYRIGHT 2013

"Reproduction or use of any materials herein without the written permission of Jeni Webber and Associates violates the copyright laws of the United States."

SHEET TITLE

## Site Plan

PROJECT NUMBER	PROJECT NAME
1	1
2	2
3	3
4	4
5	5
6	6
7	7
8	8
9	9
10	10
11	11
12	12
13	13
14	14
15	15
16	16
17	17
18	18
19	19
20	20
21	21
22	22
23	23
24	24
25	25
26	26
27	27
28	28
29	29
30	30
31	31
32	32
33	33
34	34
35	35
36	36
37	37
38	38
39	39
40	40
41	41
42	42
43	43
44	44
45	45
46	46
47	47
48	48
49	49
50	50
51	51
52	52
53	53
54	54
55	55
56	56
57	57
58	58
59	59
60	60
61	61
62	62
63	63
64	64
65	65
66	66
67	67
68	68
69	69
70	70
71	71
72	72
73	73
74	74
75	75
76	76
77	77
78	78
79	79
80	80
81	81
82	82
83	83
84	84
85	85
86	86
87	87
88	88
89	89
90	90
91	91
92	92
93	93
94	94
95	95
96	96
97	97
98	98
99	99
100	100

Steinfeld

SCALE


--	--	--	--

NORTH

SHEET NUMBER



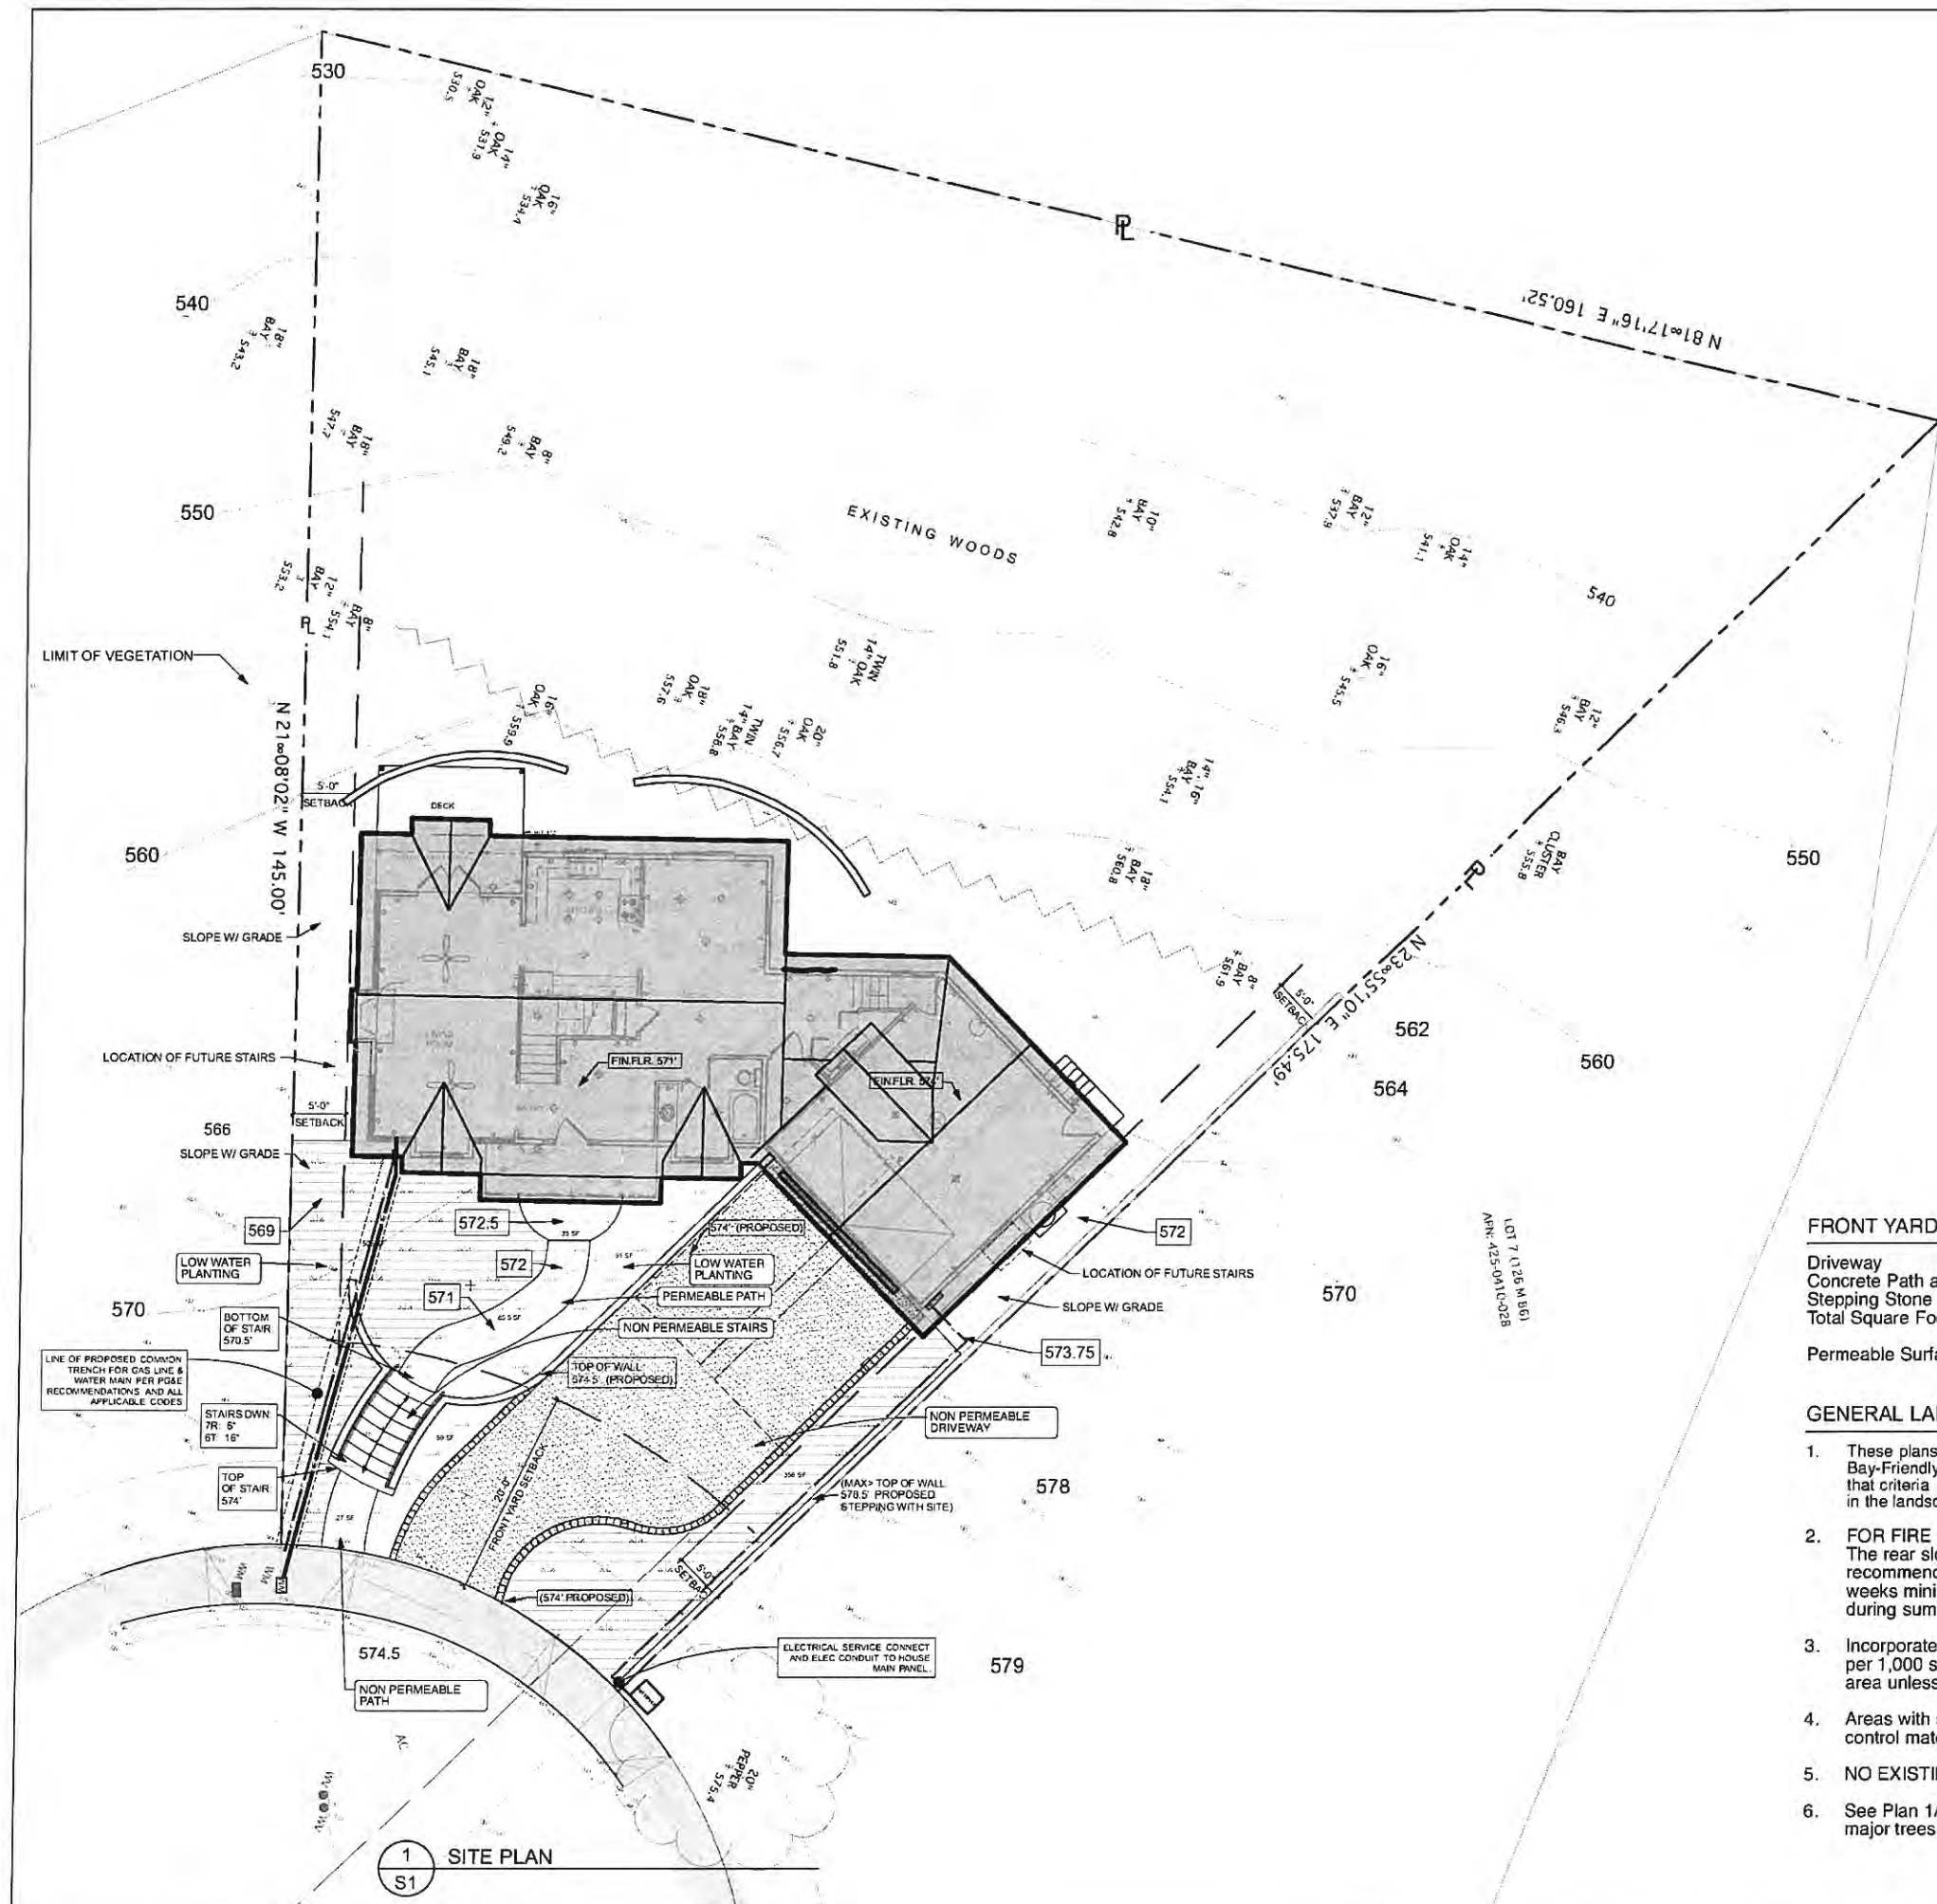


L



TOTAL LOT SIZE:	14,140 SQ.FT.
TOTAL FRONT YARD SIZE:	2,251 SQ.FT.
TOTAL PERMEABLE: (FRONT)	1,197 SQ.FT.
TOTAL NON PERMEABLE: (FRONT)	1,054 SQ.FT.

## PERMEABILITY KEY NOTES

	PERMEABLE
	NON PERMEABLE
	CITY SIDE WALK

**SYMBOLS KEY**

**KEY**

PROPERTY LINE — PL —  
BUILDING SETBACK LINE —

FRONT YARD PERMEABLE/IMPERMEABLE SURFACES:

Driveway	Impermeable	918 Square Ft.
Concrete Path and Walls	Impermeable	136 Square Ft.
Stepping Stone Path and Planting Beds	Permeable	1,197 Square Ft.
<b>Total Square Footage</b>		<b>2,251 Square Ft.</b>

Permeable Surfaces Percentage 53 Percent

### GENERAL LANDSCAPING NOTES

1. These plans comply with the criteria of 'City of Hayward Bay-Friendly Water Efficient Landscape Ordinance' and that criteria has been applied for the efficient use of water in the landscape and irrigation design plans.
2. **FOR FIRE SAFETY AND SUPPRESSION:**  
The rear slope will be thinned as per fire zone safety recommendations the plants will be watered every three weeks minimum. The native grasses will be cut to 4" ht. during summer months.
3. Incorporate compost at the rate of at least 4 cubic yards per 1,000 square feet to a depth of 6" into the landscape area unless counter-indicated by a soil test).
4. Areas with slopes greater than 3:1 to receive erosion control material.
5. **NO EXISTING TREES WILL BE REMOVED.**
6. See Plan 1/L1 for dimensions noting distances from major trees to proposed Line of Disturbance.







**Jeni Webber and Associates**  
1743 Alcatraz Avenue  
Berkeley, CA 94703  
T: 510-914-5822  
F: 510-450-9091  
CLA 3490

PROJECT  
**Steinfeld Gardens**  
2366 Rainbow Court, Hayward, CA, 94542  
LOT 6 - TRACT NO. 2392 - BOOK 126 OF MAPS PAGE 86 ALAMEDA COUNTY RECORDS  
**LANDSCAPING PLANS**  
OWNERS

**Steinfeld**  
ASSOCIATE ARCHITECT

STRUCTURAL ENGINEER

CONSULTANT


ISSUES/REVISIONS			
#	DATE	DESCRIPTION	DRAWN
2	181103		
1	181204		

STAMP  
JENI WEBBER  
#3490  
August 19, 2020  
STATE OF CALIFORNIA  
©COPYRIGHT 2013  
"Reproduction or use of any materials herein without the written permission of Jeni Webber and Associates violates the copyright laws of the United States."

SHEET TITLE  
**Irrigation Plan**  
PROJECT NUMBER PROJECT NAME  
Steinfeld  
SCALE  
3/16 inch = 1 Foot  
NORTH  
SHEET NUMBER  
**L3**

IRRIGATION LEGEND			
SYMBOL	EQUIPMENT	MANUFACTURER	NOTES/DETAIL
P.O.C.	POINT OF CONNECTION - FIELD VERIFY EXACT LOCATION	SEE SPECIFICATIONS	
WM	WATER METER		
BFPA	BACK-FLOW PREVENTER ASSEMBLY	"FEBCO" REDUCED PRESSURE SERIES 850-1	
C	IRRIGATION CONTROLLER	"IRRTROL"	
BV	BALL VALVE, BRONZE, SAME SIZE AS MAINLINE	"NIBCO"	
NV	NUMBER OF VALVE (PLACEMENT OF STUB-UP)		
STUB	STUB UP WITH THREADED CAP IN LOCKABLE 10" ROUND BOX	SEE SPECIFICATIONS	
RS	RAIN SENSOR	"IRRTROL: CLIMATE LOGIC"	
	3" PVC SCHED. 40 SLEEVE- FLAG ALL ENDS OF SLEEVES- TO BE VISIBLE ABOVE GRADE		
PR	PRESSURE REDUCER		
FILT	FILTER, SEE SPECIFICATIONS FOR SIZE	"AMAD", 1" COMPACT FOR CONSTANT PRESSURE, W/200 MICRON MESH IN DURA ECONOMY BOX	
VALV	VALVES (SEE IRRIGATION DETAILS)	SIZE VARIES SEE SPECS.	

IRRIGATION PLAN KEY NOTES	
A	WATER METER
B	MAINLINE TO HOUSE
C	TEE IN MAINLINE FOR IRRIGATION TO BACK FLOW PREVENTER
D	BALL VALVE
E	BACK FLOW PREVENTER
F	IRRIGATION METER
G	VALVE MANIFOLD
H	PRESSURE COMPENSATION IN-LINE DRIP EMMITTER
I	IN-LINE DRIP EMMITTER
J	DRIP EMMITTER @ EA. PLANT (FUTURE INSTALL)

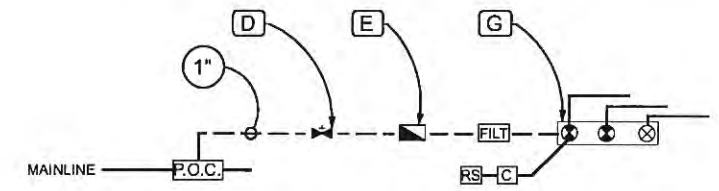


**2 IRRIGATION DIAGRAM**  
L3

WATER EFFICIENT LANDSCAPE WORK SHEET						
HYDROZONE/PLANTING DESCRIPTION	PLANT FACTOR/PF	IRRIGATION METHOD	IRRIGATION EFFICIENCY (IE)	ETAF (PF/IE)	LANDSCAPE AREA (SQ FT)	ESTIMATED TOTAL WATER USAGE (ETWU)
1- MODERATE WATER	0.4	DRIP	0.81	0.49	45 SQ FT	22.05
2- LOW WATER	0.3	DRIP	0.81	0.37	355 SQ FT	131.35
3- MODERATE WATER	0.4	DRIP	0.81	0.49	901 SQ FT	441.49
4- LOW WATER	0.3	DRIP	0.81	0.37	231 SQ FT	85.47
5- MODERATE WATER	0.4	DRIP	0.81	0.49	42 SQ FT	20.58
6- VERY LOW WATER	0	NONE	NA	NA		
					1574 SQ FT	700.94
						19192
SITE WIDE ETAF				700.94 DIV. BY 1574 =	443324	(EXCEEDS REQUIRED .55 ETAF)

THIS INFORMATION BELOW NOT TO BE INCLUDED JUST FOR ME!  
ESTIMATED TOTAL WATER USAGE (ETWU) ETO X.62 X ETAF X AREA  
44.2 FOR UNION CITY 44.2 X .62 X (27.4) .....  
PLANT FACTOR VERY LOW 0-0.1 LOW 0.1-0.3 MODERATE 0.4-0.6 HIGH 0.7-1.0

IRRIGATION LINE KEY	
MAIN LINE - COPPER, TYPE K, AS SIZED	
SCHEDULE 40 PVC MAINLINE TO VALVE (SEE PLAN FOR SIZING)	
"AGRIFIRM" IN-LINE DRIP EMMITTER TUBING 12" SPACING ALONG LINES 12" ROW SPACING .5 GPM FLOW	
"AGRIFIRM" IN-LINE DRIP EMMITTER TUBING 12" SPACING ALONG LINES 12" ROW SPACING .5 GPM FLOW	

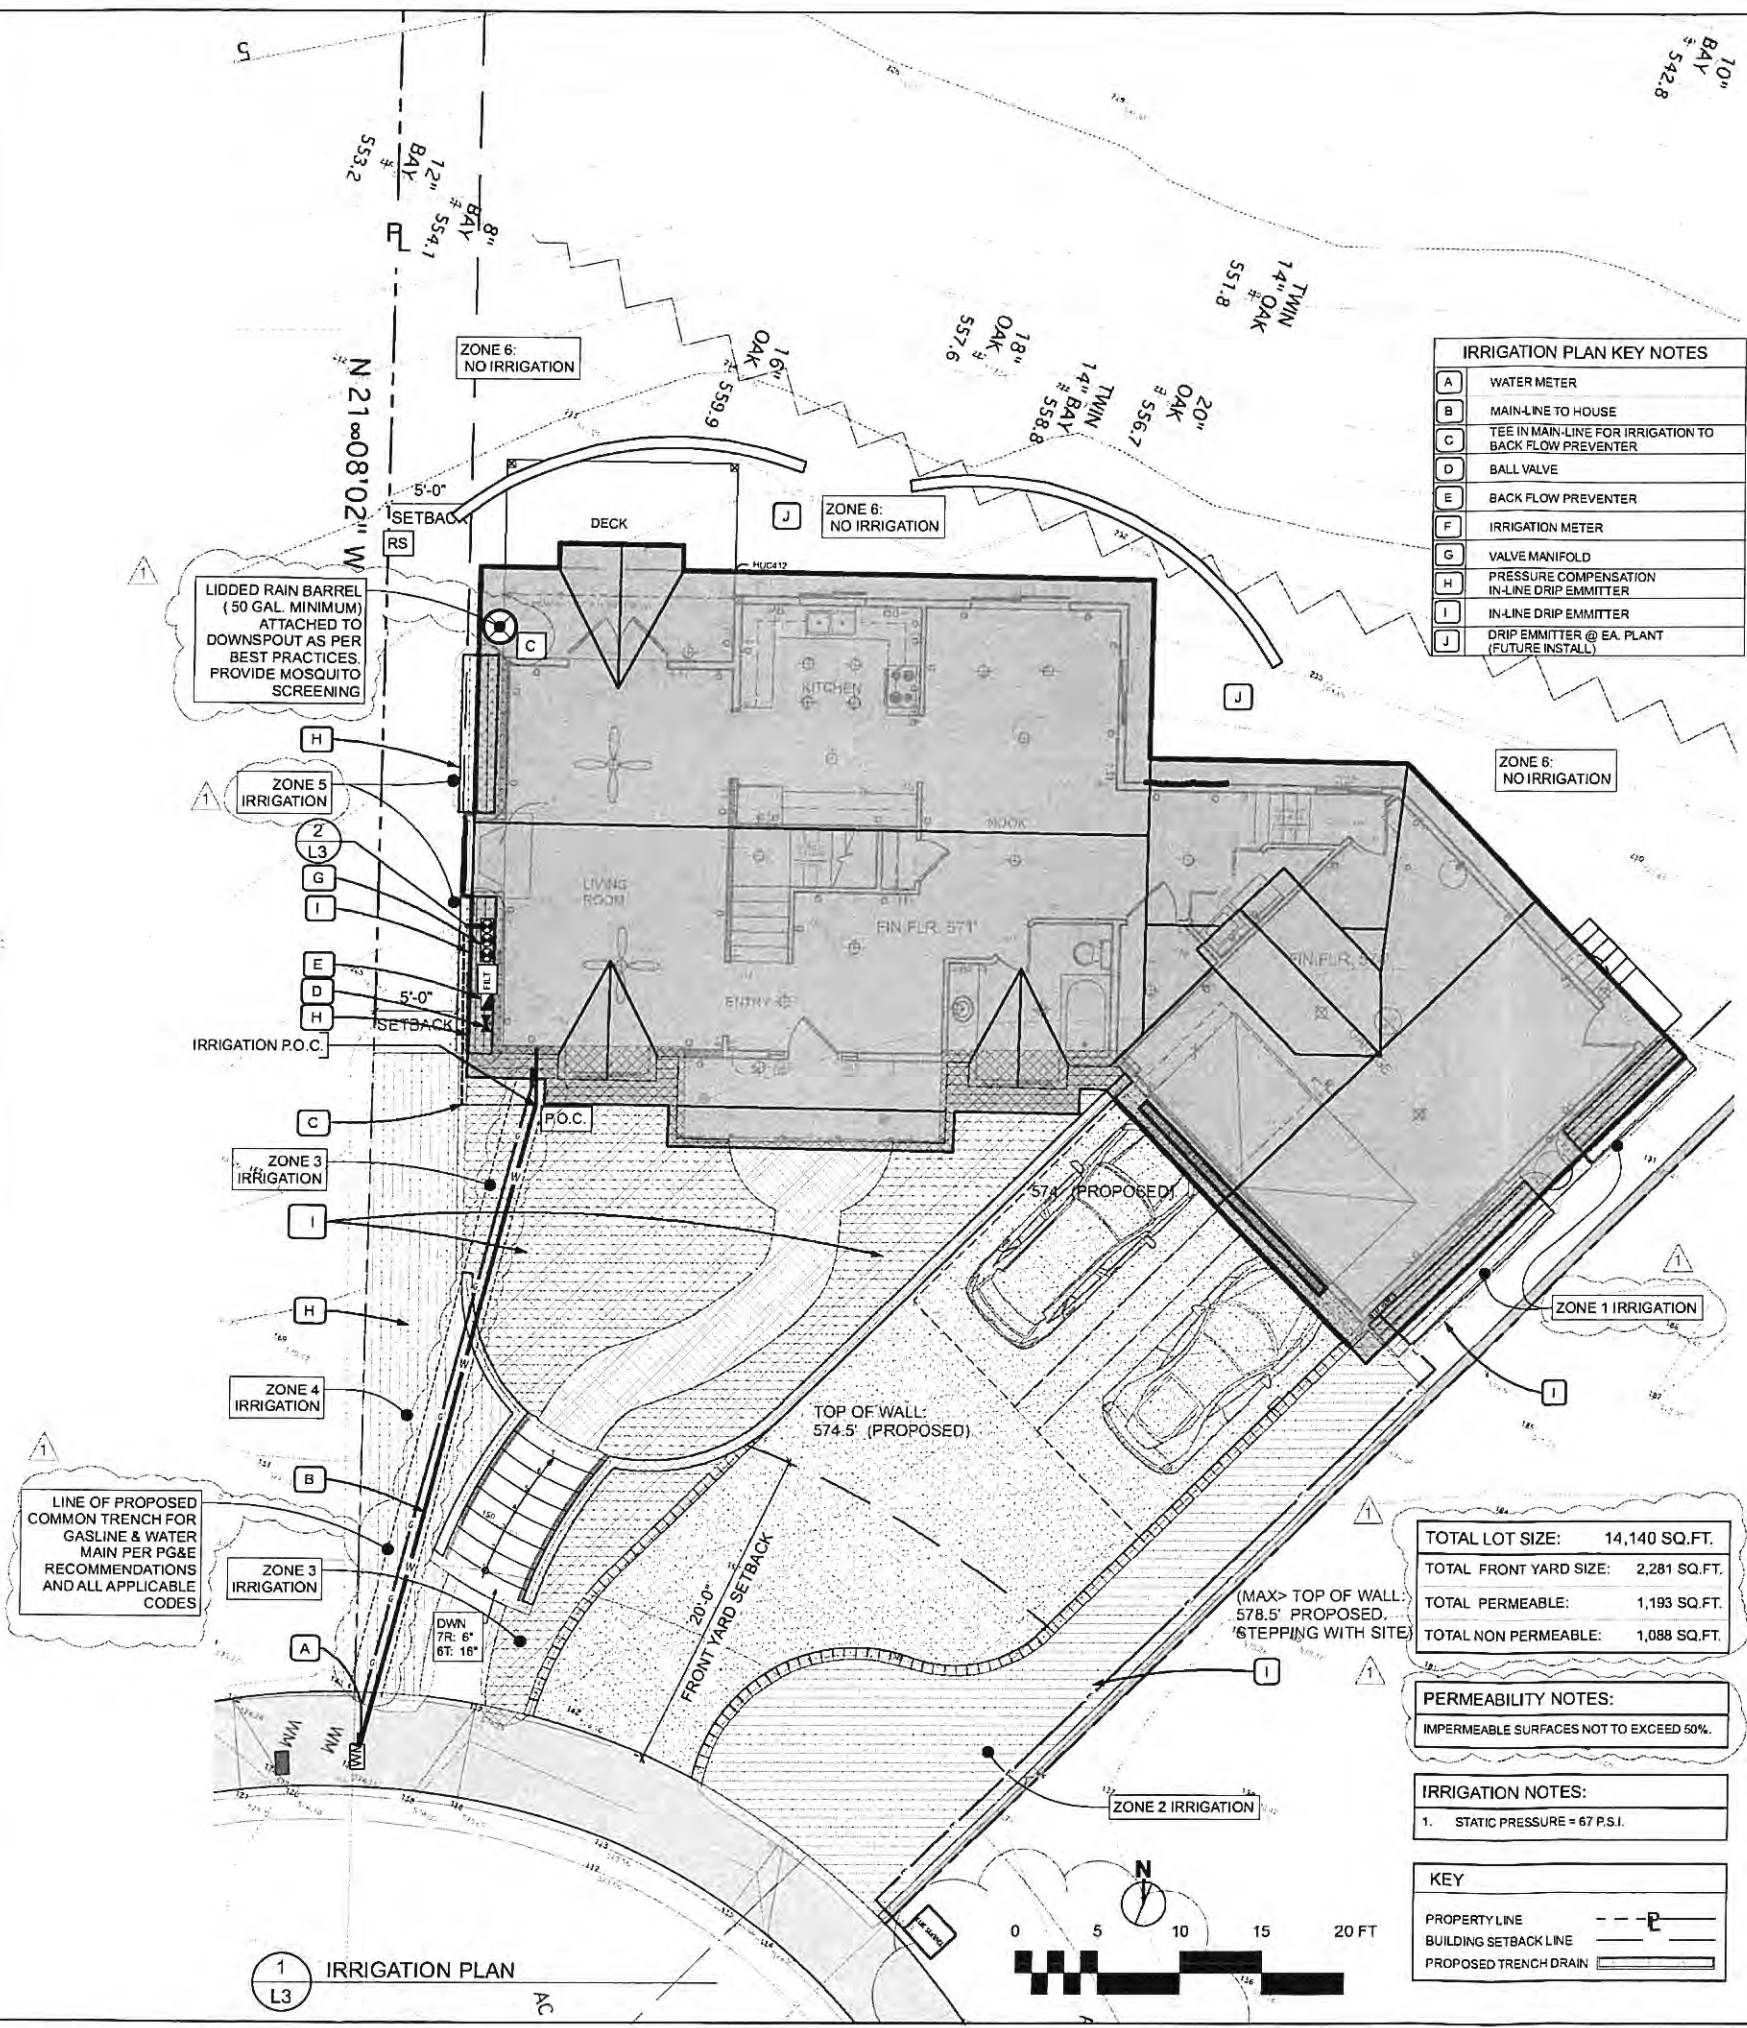

**1 IRRIGATION PLAN**  
L3







WINDOWS TO BE MILGARD DUAL GLAZED LOW E - VINYL TUSCANY

FRONT ELEVATION

SCALE 1/4" = 1'-0"

BUILDING ADDRESS NUMBERS TO BE PROVIDED ON THE FRONT OF ALL BUILDINGS AND SHALL BE VISIBLE AND LEGIBLE FROM THE STREET FRONTING THE PROPERTY. SAID NUMBERS SHALL BE 5" MIN. AND CONTRAST WITH THE BACKGROUND.



LEFT ELEVATION

SCALE 1/4" = 1'-0"

REVISIONS	BY

PACIFIC MODERN HOMES  
P.O. BOX 670  
ELK GROVE, CA.  
95759-9514  
PHONE: (916) 685-9514



PAGE TITLE

ELEVATIONS

RESIDENCE FOR:  
JOYCE STEINFELD #9422  
2366 REINBOW COURT  
HAYWARD, CA 94542

PRE-ENGINEERED  
MANCHESTER

DATE: 5/11/18  
SCALE: 1/4" = 1'-0"  
DRAWN BY: HMV  
PLAN NO.: 9422

SHEET: 1





WINDOWS TO BE MILGARD DUAL GLAZED LOW E -  
VINYL TUSCANY

REAR ELEVATION

SCALE 1/4" = 1'-0"

LANDING AT DOORS SHALL BE A MINIMUM OF  
THE WIDTH OF THE DOOR, AND EXTEND IN THE  
DIRECTION OF TRAVEL A MIN OF 36". A 42" HIGH  
GUARDRAIL WITH NO OPENING LARGE ENOUGH FOR A  
4" SPHERE TO PASS THROUGH IS REQUIRED ON  
ALL LANDINGS MORE THAN 30" ABOVE THE ADJOINING  
LEVEL OR GROUND. A HAND RAIL IS REQUIRED  
FOR STAIRS WITH FOUR (4) OR MORE RISERS.  
ALL HAND RAILS MUST BE ABLE TO WITHSTAND  
200 LB LOAD AT ANY POINT ALONG ITS LENGTH.



RIGHT ELEVATION

SCALE 1/4" = 1'-0"

REVISIONS	BY

PACIFIC MODERN HOMES  
P.O. BOX 670  
BLK GROVE, CA.  
95759-9514  
PHONE: (916) 685-9514



PAGE TITLE

ELEVATIONS

RESIDENCE FOR:  
JOYCE STEINFELD #9422  
2366 RAINBOW COURT  
HAYWARD, CA 94542

PRE-  
ENGINEERED  
MANCHESTER

DATE: 5/11/18  
SCALE: 1/4" = 1'-0"  
DRAWN BY: HV  
PLAN NO: 9422

SHEET:  
2



## RESIDENTIAL LIGHTING REQUIREMENTS

**LIGHTING CONTROLS & COMPONENTS.** ALL LIGHTING CONTROL DEVICES & SYSTEMS, BALLASTS & LUMINAIRES MUST MEET THE APPLICABLE REQUIREMENTS OF 110.9.

**JAB HIGH EFFICACY LIGHT SOURCES.** TO QUALIFY AS A JAB HIGH EFFICACY LIGHT SOURCE FOR COMPLIANCE WITH 150.0(k), A RESIDENTIAL LIGHT SOURCE MUST BE CERTIFIED TO THE ENERGY COMMISSION ACCORDING TO THE JOINT APPENDIX JAB.

**LUMINAIRE EFFICACY.** ALL INSTALLED LUMINAIRES MUST BE HIGH EFFICACY IN ACCORDANCE WITH TABLE 150.0-A.

**BLANK ELECTRICAL BOXES.** THE NUMBER OF ELECTRICAL BOXES THAT ARE MORE THAN 5 FEET ABOVE FINISHED FLOOR & DO NOT CONTAIN A LUMINAIRE OR OTHER DEVICE MUST BE NO GREATER THAN THE NUMBER OF BEDROOMS. THESE ELECTRICAL BOXES MUST BE SERVED BY A DIMMER, VACANCY SENSOR CONTROL, OR FAN SPEED CONTROL.

**RECESSED DOWNLIGHT LUMINAIRES IN CEILINGS.** LUMINAIRES RECESSED INTO CEILINGS MUST MEET ALL OF THE REQUIREMENTS FOR INSULATION CONTACT, (IC) LABELING, AIR LEAKAGE, SEALING MAINTENANCE, & SOCKET & LIGHT SOURCE AS DESCRIBED IN 150.0(k) 1C. A JAB-2016-E LIGHT SOURCE RATED FOR ELEVATED TEMPERATURE MUST BE INSTALLED BY FINAL INSPECTION IN ALL RECESSED DOWN LIGHT LUMINAIRES IN CEILINGS.

**ELECTRONIC BALLASTS.** BALLASTS FOR FLOURESCENT LAMPS RATED 13 WATTS OR GREATER MUST BE ELECTRONIC AND MUST HAVE AN OUTPUT FREQUENCY NO LESS THAN 20KHZ.

**NIGHT LIGHTS.** PERMANENTLY INSTALLED NIGHT LIGHTS AND NIGHT LIGHTS INTEGRAL TO INSTALLED LUMINAIRES OR EXHAUST FANS MUST BE RATED TO CONSUME NO MORE THAN 5 WATTS OF POWER PER LUMINAIRE OR EXHAUST FAN AS DETERMINED IN ACCORDANCE WITH 130.0(c). NIGHT LIGHTS DO NOT NEED TO BE CONTROLLED BY VACANCY SENSORS.

**LIGHTING INTEGRAL TO EXHAUST FANS.** LIGHTING INTEGRAL TO EXHAUST FANS(EXCEPT WHEN INSTALLED BY THE MANUFACTURER IN KITCHEN EXHAUST HOODS) MUST MEET THE APPLICABLE REQUIREMENTS OF 150.0(k).

**SCREW BASED LUMINAIRES.** SCREW BASED LUMINAIRES MUST NOT BE RECESSED DOWNLIGHT LUMINAIRES IN CEILINGS AND MUST CONTAIN LAMPS THAT COMPLY WITH REFERENCE JOINT APPENDIX JAB. INSTALLED LAMPS MUST BE MARKED WITH "JAB-2016" OR JAB-2016-E" AS SPECIFIED IN REFERENCE JOINT APPENDIX JAB.

**ENCLOSED LUMINAIRES.** LIGHT SOURCES INSTALLED IN ENCLOSED LUMINAIRES MUST BE JAB COMPLIANT AND MUST BE MARKED WITH "JAB-2016-E".

**INTERIOR SWITCHES AND CONTROLS.** ALL FORWARD PHASE CUT DIMMERS USED WITH LED LIGHT SOURCES MUST COMPLY WITH NEMA SSL 7A. EXHAUST FANS MUST BE SWITCHED SEPARATELY FROM LIGHTING SYSTEMS.

LUMINAIRES MUST BE SWITCHED WITH READILY ACCESSIBLE CONTROLS THAT PERMIT THE LUMINAIRES TO BE MANUALLY SWITCHED ON AND OFF.

CONTROLS AND EQUIPMENT MUST BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. NO CONTROL MUST BYPASS A DIMMER OR VACANCY SENSOR FUNCTION IF THE CONTROL IS INSTALLED TO COMPLY WITH 150.0(k).

**LIGHTING CONTROLS MUST COMPLY WITH THE APPLICABLE REQUIREMENTS OF 110.9.** AN ENERGY MANAGEMENT CONTROL SYSTEM (EMCS) MAY BE USED TO COMPLY WITH DIMMER REQUIREMENTS IF IT FUNCTIONS AS A DIMMER ACCORDING TO 110.9; MEETS THE INSTALLATION CERTIFICATE REQUIREMENTS OF 130.4; MEETS THE EMCS REQUIREMENTS OF 130.5(f); AND MEETS ALL OTHER REQUIREMENTS IN 150.0(k).

AN EMCS MAY BE USED TO COMPLY WITH VACANCY SENSOR REQUIREMENTS IN 150.0(k) IF IT MEETS ALL OF THE FOLLOWING: IT FUNCTIONS AS A VACANCY SENSOR ACCORDING TO 110.9; THE INSTALLATION CERTIFICATE REQUIREMENTS OF 130.4; THE EMCS REQUIREMENTS OF 130.5(f); AND ALL OTHER REQUIREMENTS IN 150.0(k).

A MULTITASK PROGRAMMABLE CONTROLLER MAY BE USED TO COMPLY WITH DIMMER REQUIREMENTS IN 150.0(k) IF IT PROVIDES THE FUNCTIONALITY OF A DIMMER ACCORDING TO 110.9, AND COMPLIES WITH ALL OTHER APPLICABLE REQUIREMENTS IN 150.0(k).

IN BATHROOMS, GARAGES, LAUNDRY ROOMS, AND UTILITY ROOMS, AT LEAST ONE LUMINAIRE IN EACH OF THESE SPACES MUST BE CONTROLLED BY A VACANCY SENSOR.

DIMMERS OR VACANCY SENSORS MUST CONTROL ALL LUMINAIRES REQUIRED TO HAVE LIGHT SOURCES COMPLIANT WITH REFERENCE JOINT APPENDIX JAB, EXCEPT LUMINAIRES IN CLOSETS LESS THAN 70 SQUARE FEET AND LUMINAIRES IN HALLWAYS.

UNDERCABINET LIGHTING MUST BE SWITCHED SEPARATELY FROM OTHER LIGHTING SYSTEMS.

**RESIDENTIAL OUTDOOR LIGHTING.** FOR SINGLE-FAMILY RESIDENTIAL BUILDINGS, OUTDOOR LIGHTING PERMANENTLY MOUNTED TO A RESIDENTIAL BUILDING OR TO OTHER BUILDINGS ON THE SAME LOT, MUST MEET THE REQUIREMENT IN ITEM 150.0(k)3A(ON AND OFF SWITCH) AND THE REQUIREMENTS IN EITHER ITEM 150.0(k)3A(PHOTOCELL AND MOTION SENSOR) OR ITEM 150.0(k)3A(4)(PHOTO CONTROL AND AUTOMATIC TIME SWITCH CONTROL, ASTRONOMICAL TIME CLOCK, OR EMCS.)


NOTE:  
SEE TITLE 24 SHEETS FOR RESIDENTIAL LIGHTING REQUIREMENTS.

NOTE: ALL EGRESS WINDOWS TO HAVE MAX SILL HEIGHT OF 44 INCHES. MIN CLEAR WIDTH SHALL BE 20 INCHES. MIN CLEAR HEIGHT SHALL BE 24 INCHES. MIN OPENABLE AREA SHALL BE 5.7 SQ FT.

SAFETY GLAZING TO BE IN ALL DOORS AND ANY WINDOWS WITHIN 24 INCHES OF DOOR. ALSO IN ALL WINDOWS SILLS WITHIN 18 INCHES OF FLOOR AND 60 INCHES FROM ANY TUB OR SHOWER DRAIN.

## SQUARE FOOTAGE

1ST FLOOR	1184 SQ FT
2ND FLOOR	1516 SQ FT
TOTAL LIVING	2700 SQ FT
GARAGE	528 SQ FT
CVRD PORCH	56 SQ FT

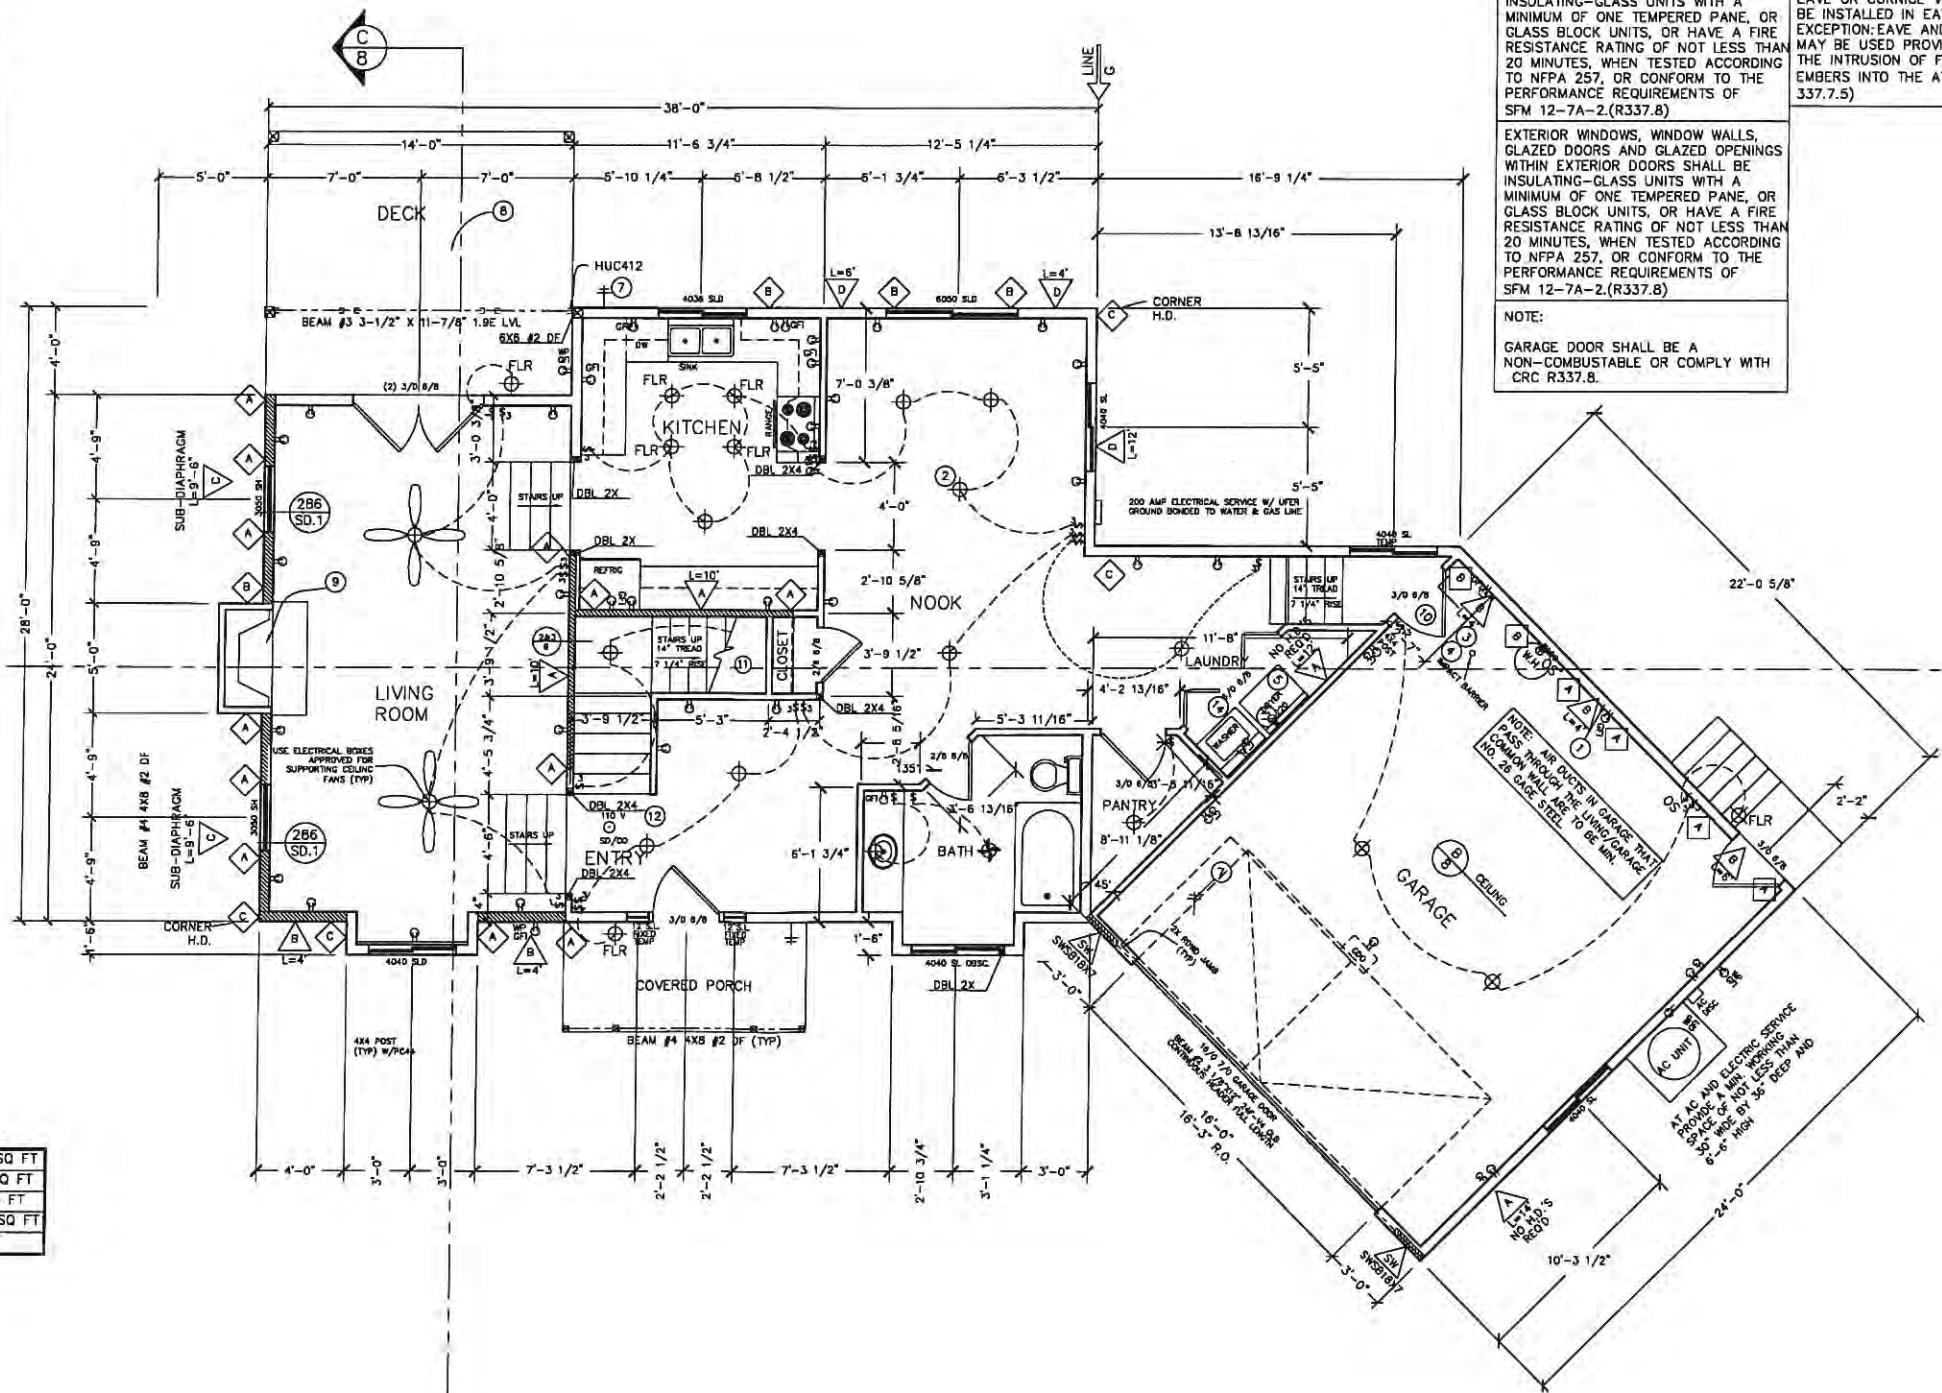

THE UNDERSIDE OF CANTILEVERED AND OVERHANGING APPENDAGES AND FLOOR PROJECTIONS SHALL MAINTAIN THE IGNITION-RESISTANT INTEGRITY OF EXTERIOR WALLS, OR THE PROJECTION SHALL BE ENCLOSED TO THE GRADE. (R337.7.6 THROUGH R337.7.9)

EXTERIOR WALLS SHALL BE APPROVED NONCOMBUSTIBLE OR IGNITION-RESISTANT MATERIAL, HEAVY TIMBER OR LOG WALL CONSTRUCTION OR SHALL PROVIDE PROTECTION FROM THE INTRUSION OF FLAMES AND EMBERS IN ACCORDANCE WITH STANDARD SFM 12-7A-1.(R337.7.3).

EXTERIOR DOOR ASSEMBLIES SHALL CONFORM TO THE PERFORMANCE REQUIREMENTS OF STANDARD SFM12-7A-1 OR SHALL BE OF APPROVED NON-COMBUSTIBLE CONSTRUCTION, OR SOLID CORE WOOD HAVING STILE AND RAILS NOT LESS THAN 1 1/2 INCHES THICK WITH INTERIOR FILL PANEL THICKNESS NO LESS THAN 1 1/2 INCHES THICK, OR SHALL HAVE A FIRE-RESISTANCE RATING OF NOT LESS THAN 20 MINUTES WHEN TESTED ACCORDING TO NFPA 252. (R337.8)

EXTERIOR WINDOWS, WINDOW WALLS, GLAZED DOORS AND GLAZED OPENINGS WITHIN EXTERIOR DOORS SHALL BE INSULATING-GLASS UNITS WITH A MINIMUM OF ONE TEMPERED PANE, OR GLASS BLOCK UNITS, OR HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 20 MINUTES, WHEN TESTED ACCORDING TO NFPA 257, OR CONFORM TO THE PERFORMANCE REQUIREMENTS OF SFM 12-7A-2.(R337.8)

EXTERIOR WINDOWS, WINDOW WALLS, GLAZED DOORS AND GLAZED OPENINGS WITHIN EXTERIOR DOORS SHALL BE INSULATING-GLASS UNITS WITH A MINIMUM OF ONE TEMPERED PANE, OR GLASS BLOCK UNITS, OR HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 20 MINUTES, WHEN TESTED ACCORDING TO NFPA 257, OR CONFORM TO THE PERFORMANCE REQUIREMENTS OF SFM 12-7A-2.(R337.8)

NOTE:  
GARAGE DOOR SHALL BE A NON-COMBUSTIBLE OR COMPLY WITH CRC R337.8.

EAVE AND SOFFIT PROTECTION SHALL MEET THE REQUIREMENTS OF SFM 12-7A-3 OR SHALL BE PROTECTED BY IGNITION-RESISTANT MATERIALS OR NONCOMBUSTIBLE CONSTRUCTION ON EXPOSED UNDERSIDE.(R337.7.4 AND 337.7.5)

ROOF VALLEYS WHEN PROVIDED, VALLEY FLASHINGS SHALL NOT BE LESS THAN 0.019-INCH (0.48 MM)(NO.26 GALVANIZED SHEET GAUGE) CORROSION-RESISTANT METAL INSTALLED OVER A MINIMUM 3/8 INCH WIDE (9.14 MM) UNDERLAYMENT CONSISTING OF ONE LAYER OF NO.72 ASTM CAP SHEET RUNNING THE FULL LENGTH OF VALLEY.(R337.5)

ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER.(R337.5)

ATTIC VENTILATION IN ACCORDANCE WITH SECTION 1203, ROOF AND VENTS SHALL RESIST THE INTRUSION OF FLAME AND EMBERS INTO THE ATTIC AREA OF THE STRUCTURE, OR SHALL BE PROTECTED BY CORROSION-RESISTANT, NONCOMBUSTIBLE WIRE MESH MIN OF 1/8 INCH (1.6MM) & MAX 1/2 INCH (3.2MM) OPENINGS.(R337.6)

EAVE OR CORNICE VENTS SHALL NOT BE INSTALLED IN EAVES AND CORNICES EXCEPT: EAVE AND CORNICE VENTS MAY BE USED PROVIDED THEY RESIST THE INTRUSION OF FLAME AND BURNING EMBERS INTO THE ATTIC.(R337.7.4 AND 337.7.5)



FIRST FLOOR PLAN

RESIDENCE FOR:  
JOYCE STEINFELD #9422  
2366 RAINBOW COURT  
HAYWARD, CA 94542

PRE-ENGINEERED  
MANCHESTER

DATE: 5/11/18  
SCALE: 1/4" = 1'-0"  
DRAWN BY: HV  
PLAN NO.: 9422  
SHEET: 3





SECOND FLOOR PLAN

RESIDENCE FOR  
JOYCE STEINFELD #9422  
2366 RAINBOW COURT  
HAYWARD, CA 94542

PRE-ENGINEERED  
MANCHESTER

DATE: 5/11/18  
SCALE: 1/4" = 1'-0"  
DRAWN BY: HV  
PLAN NO.: 9422  
SHEET: 4

**RESIDENTIAL LIGHTING REQUIREMENTS**

**LIGHTING CONTROLS & COMPONENTS.** ALL LIGHTING CONTROL DEVICES & SYSTEMS, BALLASTS & LUMINAIRES MUST MEET THE APPLICABLE REQUIREMENTS OF 110.9

**JAB HIGH EFFICACY LIGHT SOURCES.** TO QUALIFY AS A JAB HIGH EFFICACY LIGHT SOURCE FOR COMPLIANCE WITH 150.0(k), A RESIDENTIAL LIGHT SOURCE MUST BE CERTIFIED TO THE ENERGY COMMISSION ACCORDING TO THE JOINT APPENDIX JAB.

**LUMINAIRE EFFICACY.** ALL INSTALLED LUMINAIRES MUST BE HIGH EFFICACY IN ACCORDANCE WITH TABLE 150.0-A.

**BLANK ELECTRICAL BOXES.** THE NUMBER OF ELECTRICAL BOXES THAT ARE MORE THAN 5 FEET ABOVE FINISHED FLOOR & DO NOT CONTAIN A LUMINAIRE OR OTHER DEVICE MUST BE NO GREATER THAN THE NUMBER OF BEDROOMS. THESE ELECTRICAL BOXES MUST BE SERVED BY A DIMMER, VACANCY SENSOR CONTROL, OR FAN SPEED CONTROL.

**RECESSED DOWNLIGHT LUMINAIRES IN CEILINGS.** LUMINAIRES RECESSED INTO CEILINGS MUST MEET ALL OF THE REQUIREMENTS FOR INSULATION CONTACT, (IC) LABELING, AIR LEAKAGE, SEALING MAINTENANCE, & SOCKET & LIGHT SOURCE AS DESCRIBED IN 150.0(k) (1). A JAB-2016-E LIGHT SOURCE RATED FOR ELEVATED TEMPERATURE MUST BE INSTALLED BY FINAL INSPECTION IN ALL RECESSED DOWN LIGHT LUMINAIRES IN CEILINGS.

**ELECTRONIC BALLASTS.** BALLASTS FOR FLOURESCENT LAMPS RATED 13 WATTS OR GREATER MUST BE ELECTRONIC AND MUST HAVE AN OUTPUT FREQUENCY NO LESS THAN 20KHZ.

**NIGHT LIGHTS.** PERMANENTLY INSTALLED NIGHT LIGHTS AND NIGHT LIGHTS INTEGRAL TO INSTALLED LUMINAIRES OR EXHAUST FANS MUST BE RATED TO CONSUME NO MORE THAN 5 WATTS OF POWER PER LUMINAIRE OR EXHAUST FAN AS DETERMINED IN ACCORDANCE WITH 130.0(c). NIGHT LIGHTS DO NOT NEED TO BE CONTROLLED BY VACANCY SENSORS.

**LIGHTING INTEGRAL TO EXHAUST FANS.** LIGHTING INTEGRAL TO EXHAUST FANS (EXCEPT WHEN INSTALLED BY THE MANUFACTURER IN KITCHEN EXHAUST HOODS) MUST MEET THE APPLICABLE REQUIREMENTS OF 150.0(k).

**SCREW BASED LUMINAIRES.** SCREW BASED LUMINAIRES MUST NOT BE RECESSED DOWNLIGHT LUMINAIRES IN CEILINGS AND MUST CONTAIN LAMPS THAT COMPLY WITH REFERENCE JOINT APPENDIX JAB. INSTALLED LAMPS MUST BE MARKED WITH "JAB-2016" OR JAB-2016-E" AS SPECIFIED IN REFERENCE JOINT APPENDIX JAB.

**ENCLOSED LUMINAIRES.** LIGHT SOURCES INSTALLED IN ENCLOSED LUMINAIRES MUST BE JAB COMPLIANT AND MUST BE MARKED WITH "JAB-2016-E".

**INTERIOR SWITCHES AND CONTROLS.** ALL FORWARD PHASE CUT DIMMERS USED WITH LED LIGHT SOURCES MUST COMPLY WITH NEMA SSL 7A.

**EXHAUST FANS.** EXHAUST FANS MUST BE SWITCHED SEPARATELY FROM LIGHTING SYSTEMS. LUMINAIRES MUST BE SWITCHED WITH READILY ACCESSIBLE CONTROLS THAT PERMIT THE LUMINAIRES TO BE MANUALLY SWITCHED ON AND OFF.

**CONTROLS AND EQUIPMENT.** MUST BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. NO CONTROL MUST BYPASS A DIMMER OR VACANCY SENSOR FUNCTION IF THE CONTROL IS INSTALLED TO COMPLY WITH 150.0(k).

**LIGHTING CONTROLS.** MUST COMPLY WITH THE APPLICABLE REQUIREMENTS OF 110.9

**AN ENERGY MANAGEMENT CONTROL SYSTEM (EMCS) MAY BE USED TO COMPLY WITH DIMMER REQUIREMENTS IF IT FUNCTIONS AS A DIMMER ACCORDING TO 110.9; MEETS THE INSTALLATION CERTIFICATE REQUIREMENTS OF 130.4; MEETS THE EMCS REQUIREMENTS OF 130.5(i); AND MEETS ALL OTHER REQUIREMENTS IN 150.0(k)2.**

**AN EMCS MAY BE USED TO COMPLY WITH VACANCY SENSOR REQUIREMENTS IN 150.0(k) IF IT MEETS ALL OF THE FOLLOWING: IT FUNCTIONS AS A VACANCY SENSOR ACCORDING TO 110.9; THE INSTALLATION CERTIFICATE REQUIREMENTS OF 130.4; THE EMCS REQUIREMENTS OF 130.5(i); AND ALL OTHER REQUIREMENTS IN 150.0(k)2.**

**A MULTISCENE PROGRAMMABLE CONTROLLER MAY BE USED TO COMPLY WITH DIMMER REQUIREMENTS IN 150.0(k) IF IT PROVIDES THE FUNCTIONALITY OF A DIMMER ACCORDING TO 110.9, AND COMPLIES WITH ALL OTHER APPLICABLE REQUIREMENTS IN 150.0(k)2.**


**IN BATHROOMS, GARAGES, LAUNDRY ROOMS, AND UTILITY ROOMS, AT LEAST ONE LUMINAIRE IN EACH OF THESE SPACES MUST BE CONTROLLED BY A VACANCY SENSOR.**

**DIMMERS OR VACANCY SENSORS MUST CONTROL ALL LUMINAIRES REQUIRED TO HAVE LIGHT SOURCES COMPLIANT WITH REFERENCE JOINT APPENDIX JAB, EXCEPT LUMINAIRES IN CLOSETS LESS THAN 70 SQUARE FEET AND LUMINAIRES IN HALLWAYS.**

**UNDERCABINET LIGHTING MUST BE SWITCHED SEPARATELY FROM OTHER LIGHTING SYSTEMS.**

**RESIDENTIAL OUTDOOR LIGHTING.** FOR SINGLE-FAMILY RESIDENTIAL BUILDINGS, OUTDOOR LIGHTING PERMANENTLY MOUNTED TO A RESIDENTIAL BUILDING OR TO OTHER BUILDINGS ON THE SAME LOT, MUST MEET THE REQUIREMENT IN ITEM 150.0(k)3A(ON AND OFF SWITCH) AND THE REQUIREMENTS IN EITHER ITEM 150.0(k)3A(II)(PHOTOCELL AND MOTION SENSOR) OR ITEM 150.0(k)3A(III)(PHOTO CONTROL AND AUTOMATIC TIME SWITCH CONTROL, ASTRONOMICAL TIME CLOCK, OR EMCS.)

NOTE:  
SEE TITLE 24 SHEETS FOR RESIDENTIAL LIGHTING REQUIREMENTS.

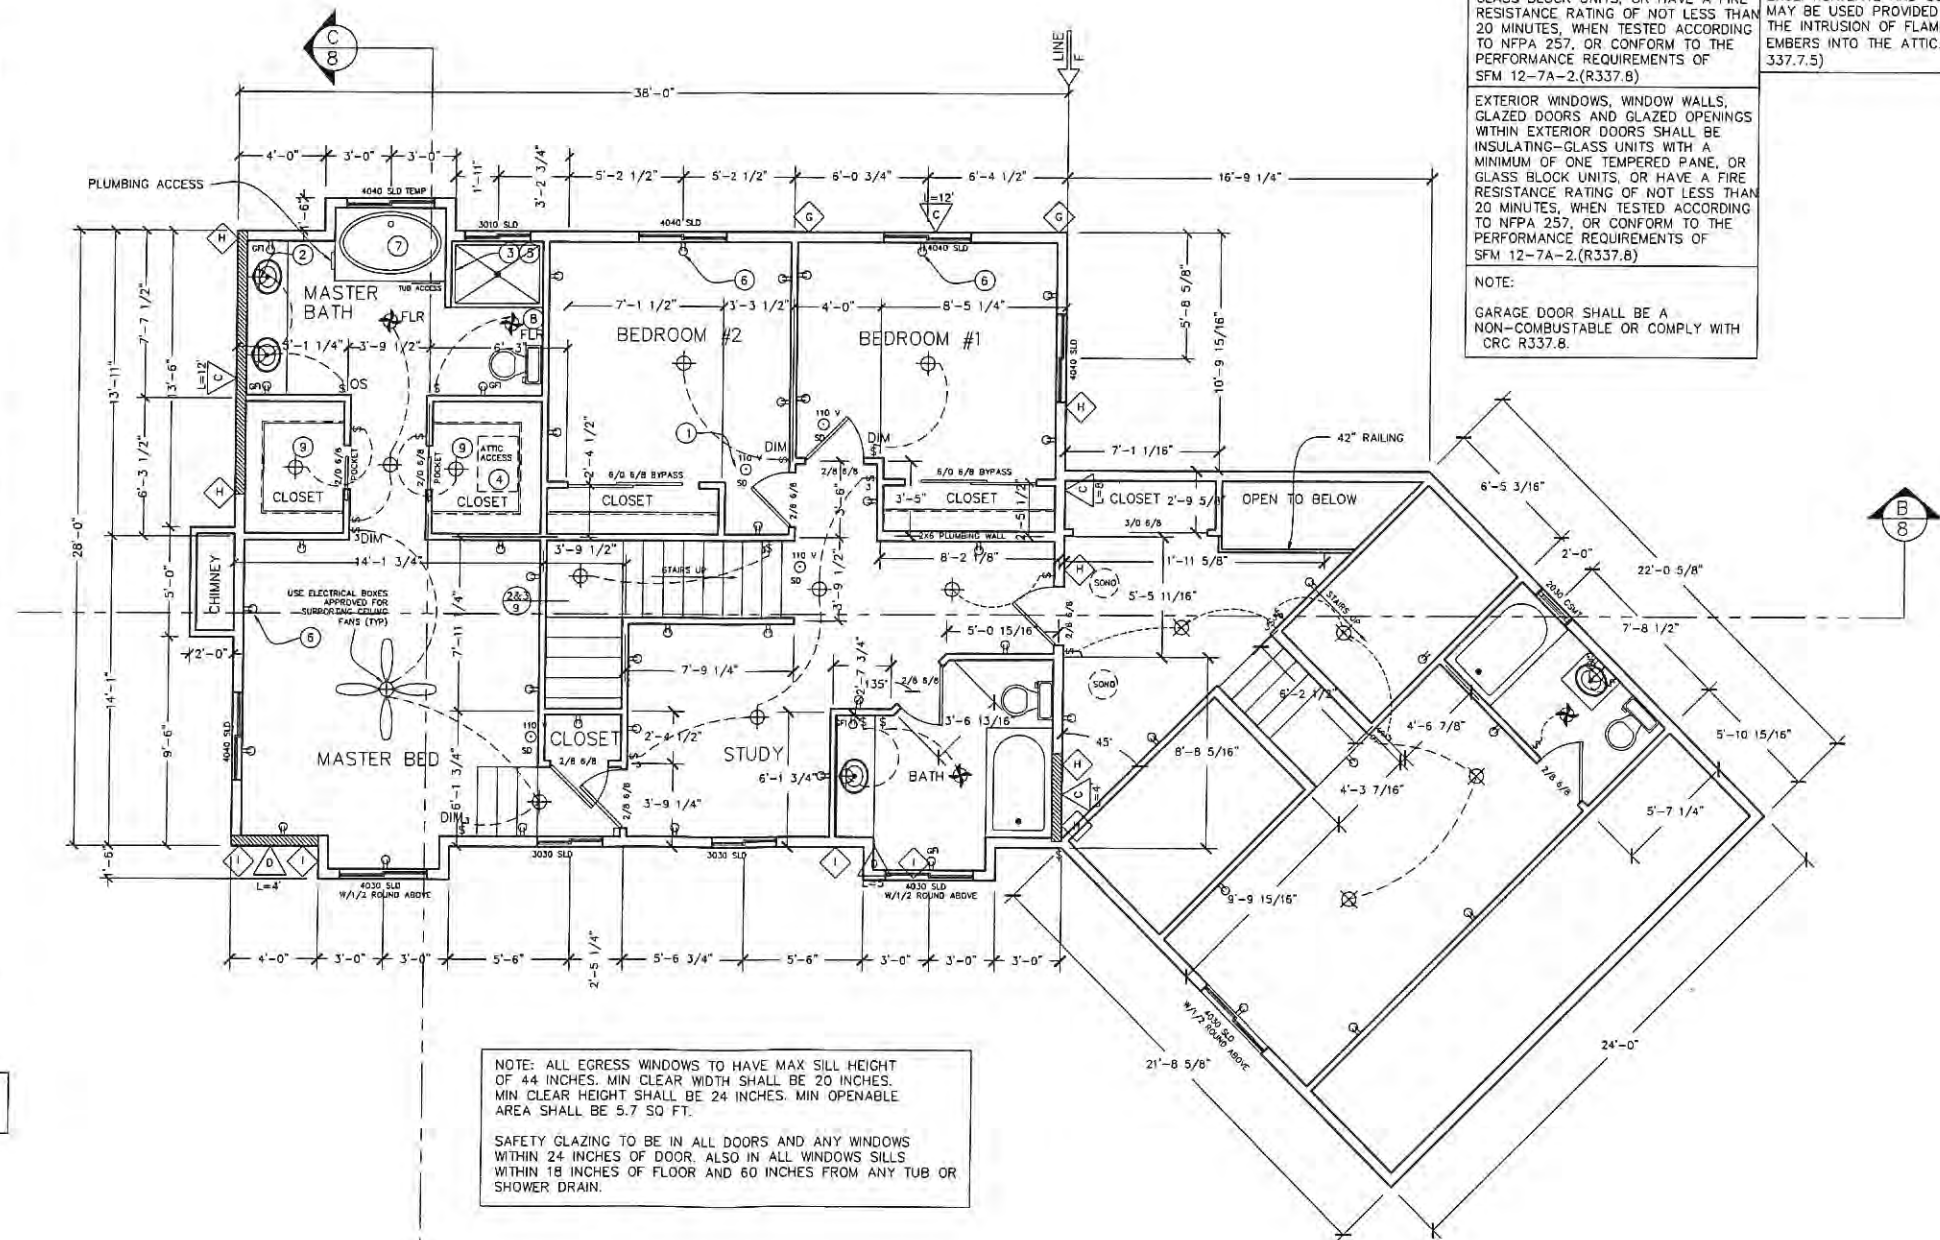

NOTE: ALL EGRESS WINDOWS TO HAVE MAX SILL HEIGHT OF 44 INCHES. MIN CLEAR WIDTH SHALL BE 20 INCHES. MIN CLEAR HEIGHT SHALL BE 24 INCHES. MIN OPENABLE AREA SHALL BE 5.7 SQ FT.

SAFETY GLAZING TO BE IN ALL DOORS AND ANY WINDOWS WITHIN 24 INCHES OF DOOR. ALSO IN ALL WINDOWS SILLS WITHIN 18 INCHES OF FLOOR AND 60 INCHES FROM ANY TUB OR SHOWER DRAIN.

THE UNDERSIDE OF CANTILEVERED AND OVERHANGING APPENDAGES AND FLOOR PROJECTIONS SHALL MAINTAIN THE IGNITION-RESISTANT INTEGRITY OF EXTERIOR WALLS, OR THE PROJECTION SHALL BE ENCLOSED TO THE GRADE. (R337.7.6 THROUGH R337.7.9)

EXTERIOR WALLS SHALL BE APPROVED NONCOMBUSTIBLE OR IGNITION-RESISTANT MATERIAL, HEAVY TIMBER OR LOG WALL CONSTRUCTION OR SHALL PROVIDE PROTECTION FROM THE INTRUSION OF FLAMES AND EMBERS IN ACCORDANCE WITH STANDARD SFM 12-7A-1.(R337.7.3).

EXTERIOR DOOR ASSEMBLIES SHALL CONFORM TO THE PERFORMANCE REQUIREMENTS OF STANDARD SFM12-7A-1 OR SHALL BE OF APPROVED NON-COMBUSTIBLE CONSTRUCTION, OR SOLID CORE WOOD HAVING STILE AND RAILS NOT LESS THAN 1 1/2 INCHES THICK WITH INTERIOR FIELD PANEL THICKNESS NO LESS THAN 1 1/2 INCHES THICK, OR SHALL HAVE A FIRE-RESISTANCE RATING OF NOT LESS THAN 20 MINUTES WHEN TESTED ACCORDING TO NFPA 252. (R337.8)

EXTERIOR WINDOWS, WINDOW WALLS, GLAZED DOORS AND GLAZED OPENINGS WITHIN EXTERIOR DOORS SHALL BE INSULATING-GLASS UNITS WITH A MINIMUM OF ONE TEMPERED PANE, OR GLASS BLOCK UNITS, OR HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 20 MINUTES, WHEN TESTED ACCORDING TO NFPA 257, OR CONFORM TO THE PERFORMANCE REQUIREMENTS OF SFM 12-7A-2.(R337.8)

NOTE:  
GARAGE DOOR SHALL BE A NON-COMBUSTIBLE OR COMPLY WITH CRC R337.8.

EAVE AND SOFFIT PROTECTION SHALL MEET THE REQUIREMENTS OF SFM 12-7A-3 OR SHALL BE PROTECTED BY IGNITION-RESISTANT MATERIALS OR NONCOMBUSTIBLE CONSTRUCTION ON EXPOSED UNDERSIDE.(R337.7.4 AND 337.7.5)

ROOF VALLEYS WHEN PROVIDED, VALLEY FLASHINGS SHALL NOT BE LESS THAN 0.019-INCH (0.48 MM)(NO.26 GALVANIZED SHEET GAUGE) CORROSION-RESISTANT METAL INSTALLED OVER A MINIMUM 36 INCH WIDE (914 MM) UNDERLAYMENT CONSISTING OF ONE LAYER OF NO.72 ASTM CAP SHEET RUNNING THE FULL LENGTH OF VALLEY.(R337.5)

ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER.(R337.5)

ATTIC VENTILATION IN ACCORDANCE WITH SECTION 1203, ROOF AND VENTS SHALL RESIST THE INTRUSION OF FLAME AND EMBERS INTO THE ATTIC AREA OF THE STRUCTURE, OR SHALL BE PROTECTED BY CORROSION-RESISTANT, NONCOMBUSTIBLE WIRE MESH MIN OF 1/8 INCH (1.6MM) & MAX 1/2 INCH (3.2MM) OPENINGS .(R337.6)

EAVE OR CORNICE VENTS SHALL NOT BE INSTALLED IN EAVES AND CORNICES EXCEPT:EAVE AND CORNICE VENTS MAY BE USED PROVIDED THEY RESIST THE INTRUSION OF FLAME AND BURNING EMBERS INTO THE ATTIC.(R337.7.4 AND 337.7.5)